


Ductwork Layout for Oskar Unit Plan View

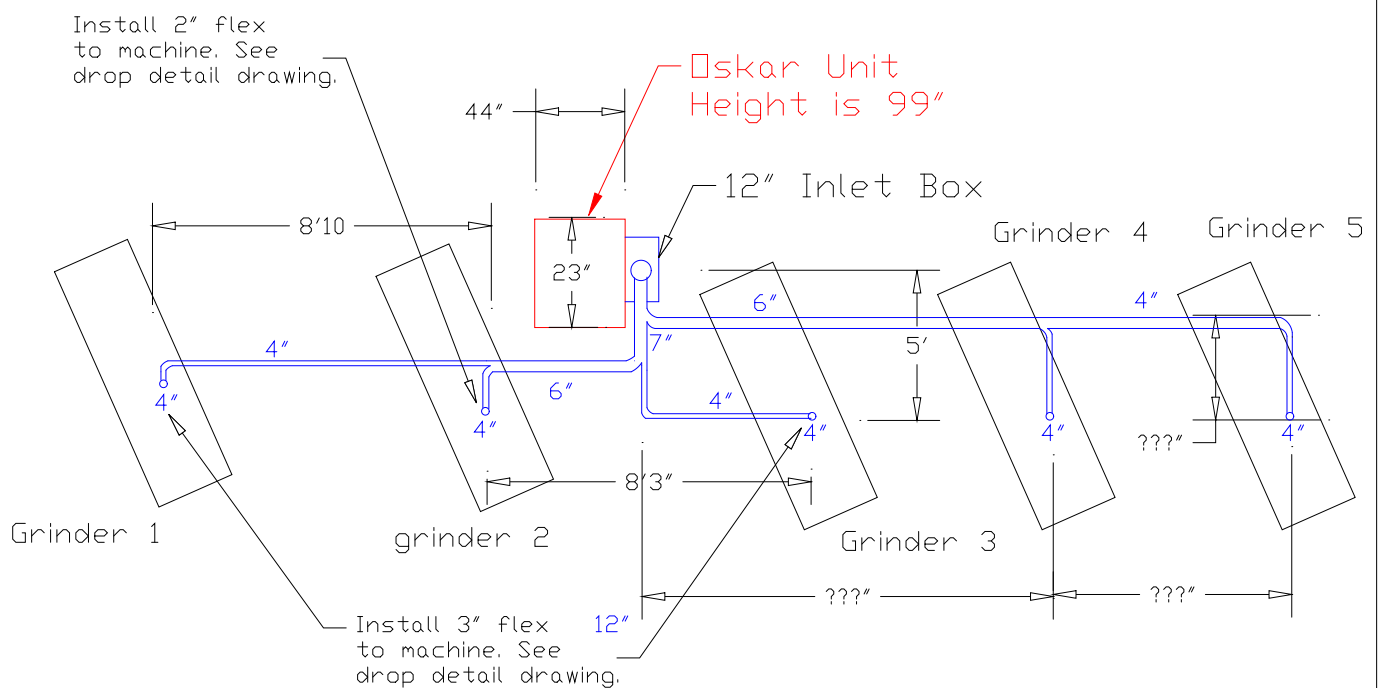

Notes:

1. All drops to have blastgates to allow for air flow adjustment
2. Ceiling height is 19'
3. Install 12" bleed valve in vertical position of 12" duct.
4. Electrical requirements.
Motor is 2Hp 460 volts 3Phase 60 Hertz TEFC
Full load amps are 4.0

Industrial Air Quality	
102 AG DRIVE	
Youngsville, NC 27596	
P# 919-562-7181	F# 919-562-7182
Project: Becton Dickson	
Drawing: Oskar Duct layout	
Date: 11/30/07	Drawn by: RAV
Revision Date: 12/19/07 DDJ	

IAQ