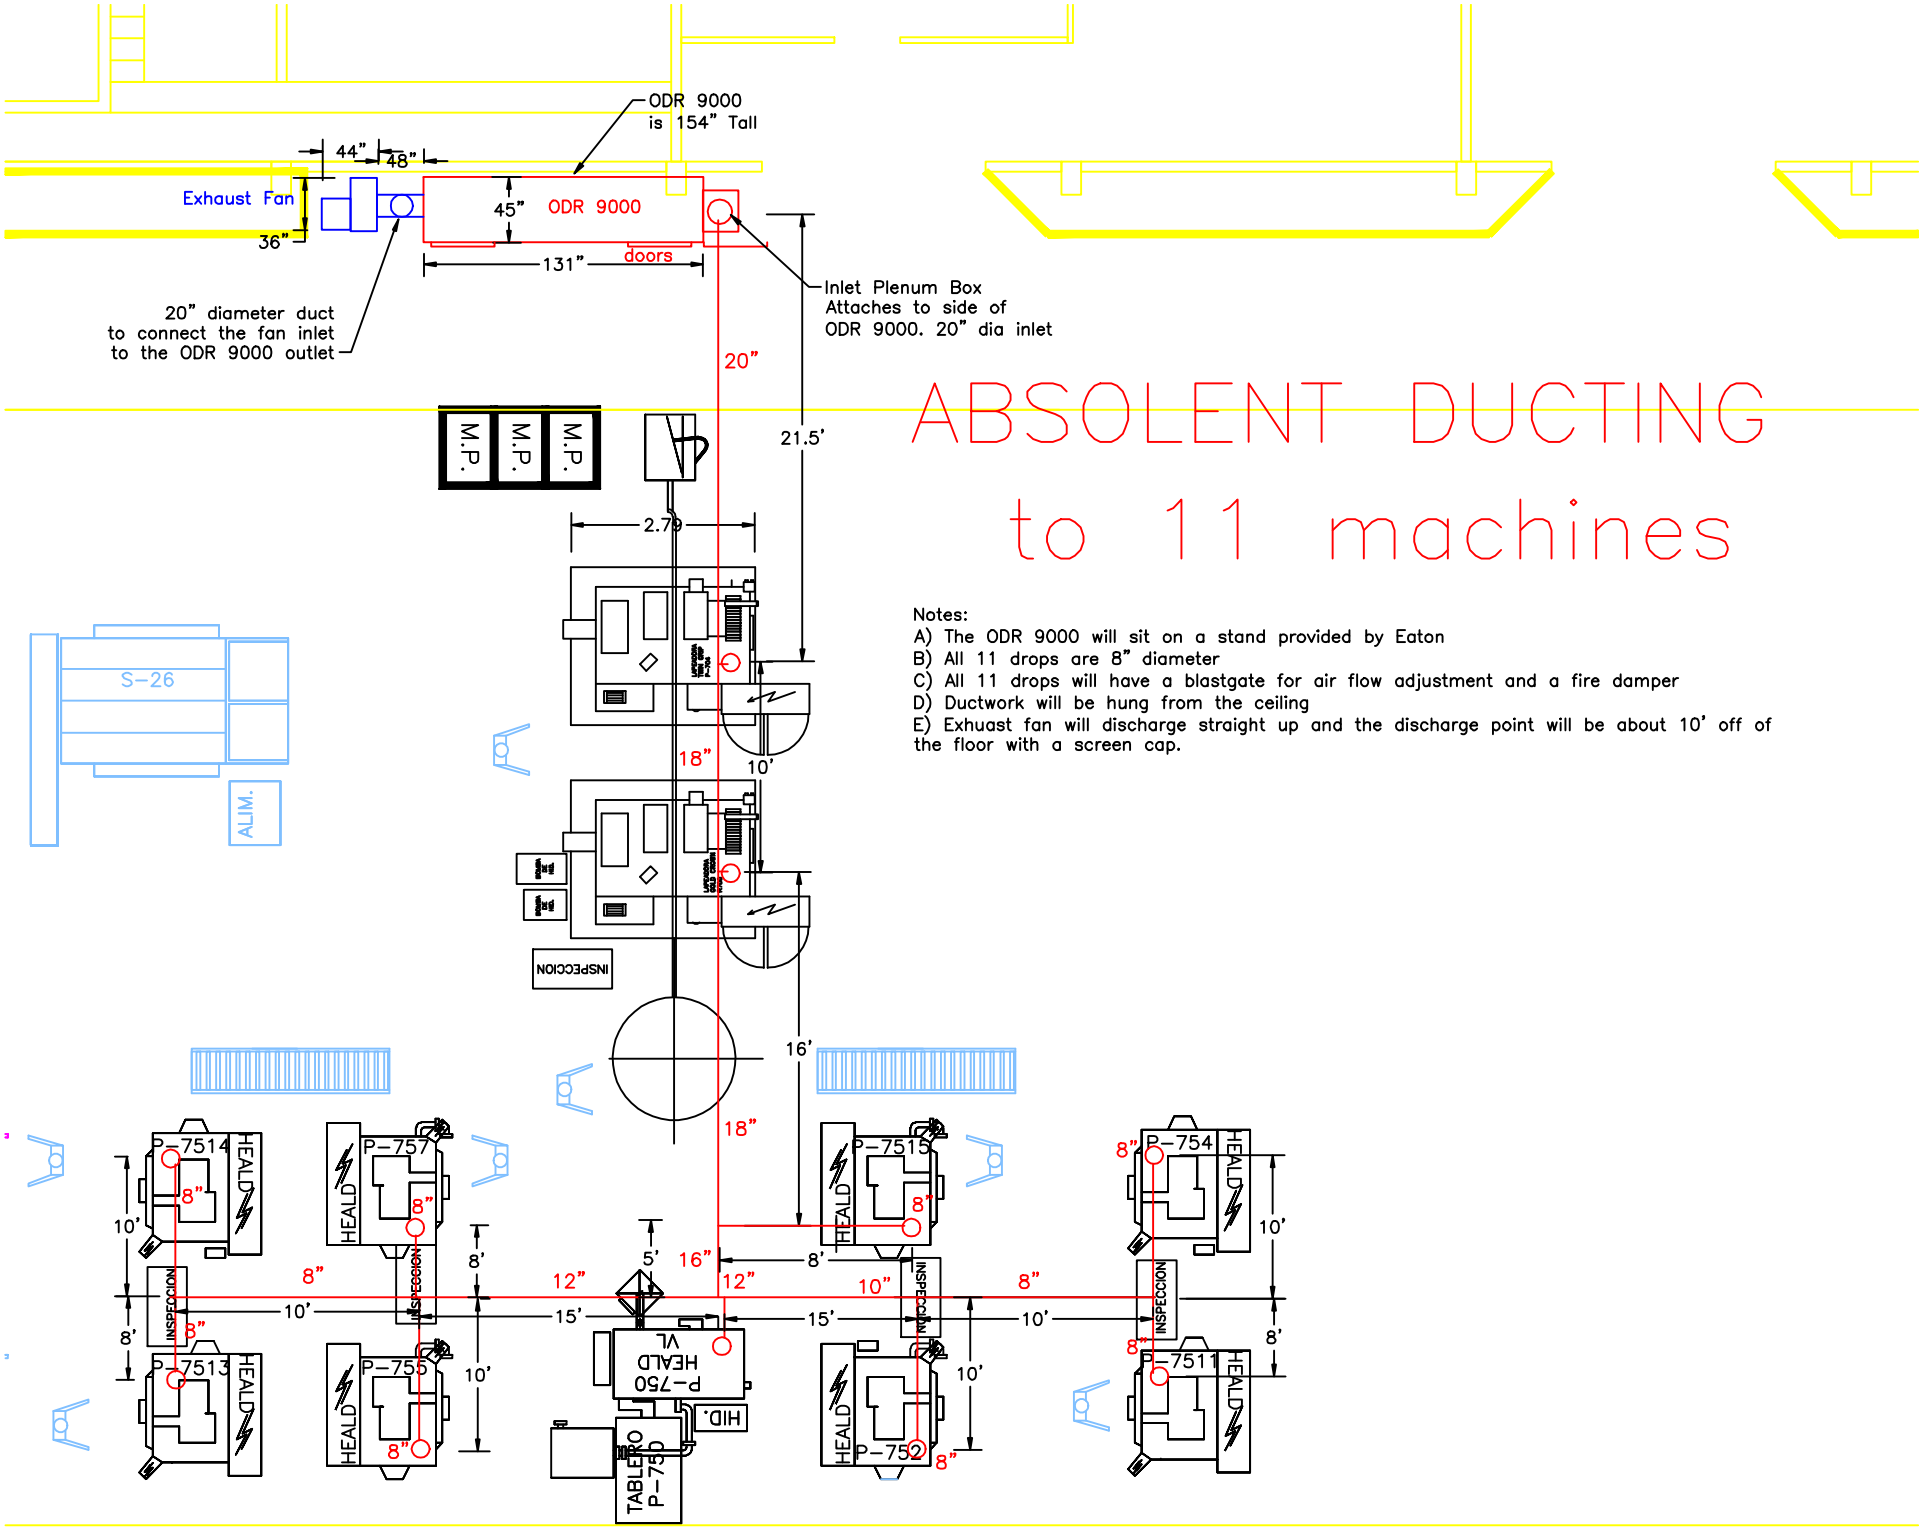

Notes:
A) The ODR 9000 will sit on a stand provided by Eaton
B) All 11 drops are 8" diameter
C) All 11 drops will have a blastgate for air flow adjustment and a fire damper
D) Ductwork will be hung from the ceiling
E) Exhuast fan will discharge straight up and the discharge point will be about 10' off of the floor with a screen cap.