
Plan View of Ductwork Layout Block Line - #1 - CNC Cell #1

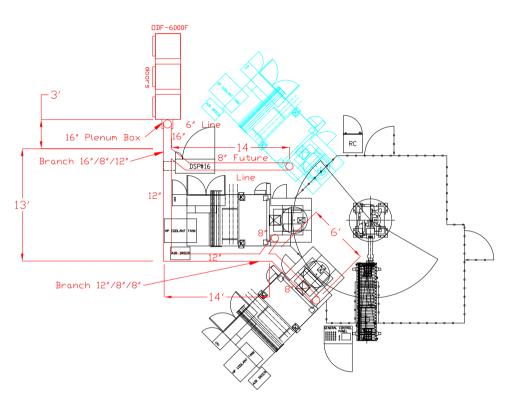

Notes:
A) Each drop will have a Butterfly damper for airflow adjustment.
B) Each drop will have a Bleed in valve to allow for balancing.
C) DDF 6000F has 3 - 3.5HP 460volt 3Phase motors. Full load amps are 4.6amps each.

D) Drain line: P-Trap made of $\frac{3}{4}$ Galvanized with ball valve and unions. IAQ to provide. Honda to provide piping to sump.

Industrial Air Quality
95 CYPRESS DRIVE
YOUNGSVILE, NC 27596
Project: Honda Canada
Drawing:Block #1 CNC Cell #1
Date:03/27/08 Drawn by:WWB

Sheet No: