Ductwork Layout for Dust collector

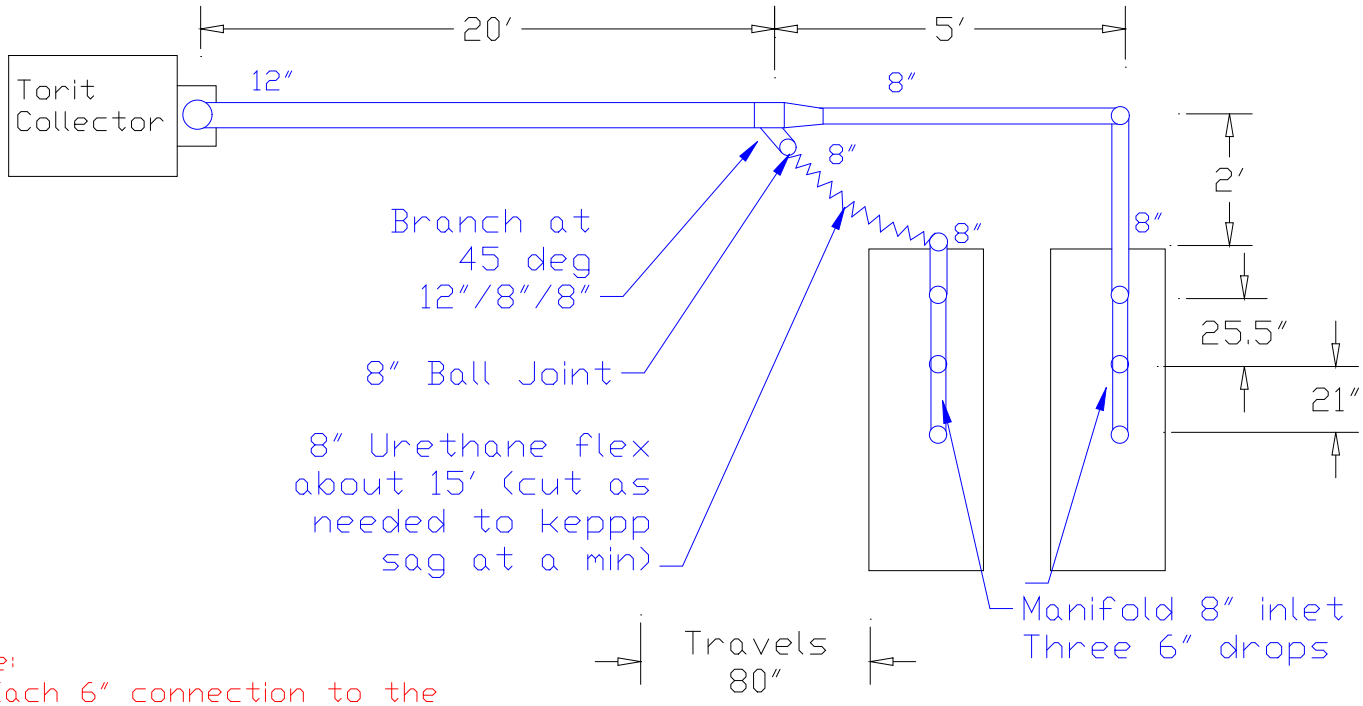

Note:
A) Each 6″ connection to the machine has a 6″ ID Collar. Attach a reducer to each drop, 6.125″ID to 6″ rolled edge.

Industrial Air Quality 102 AG DRIVE Youngsville, NC 27596 P# 919-562-7181 F# 919-562-7182	IAQ
Project: PSI Temple, TX	
Drawing: Ductwork layout	
Date: 4/3/08	Drawn by: RAV
Sheet No:	