


Dust Collector layout details

Plan View

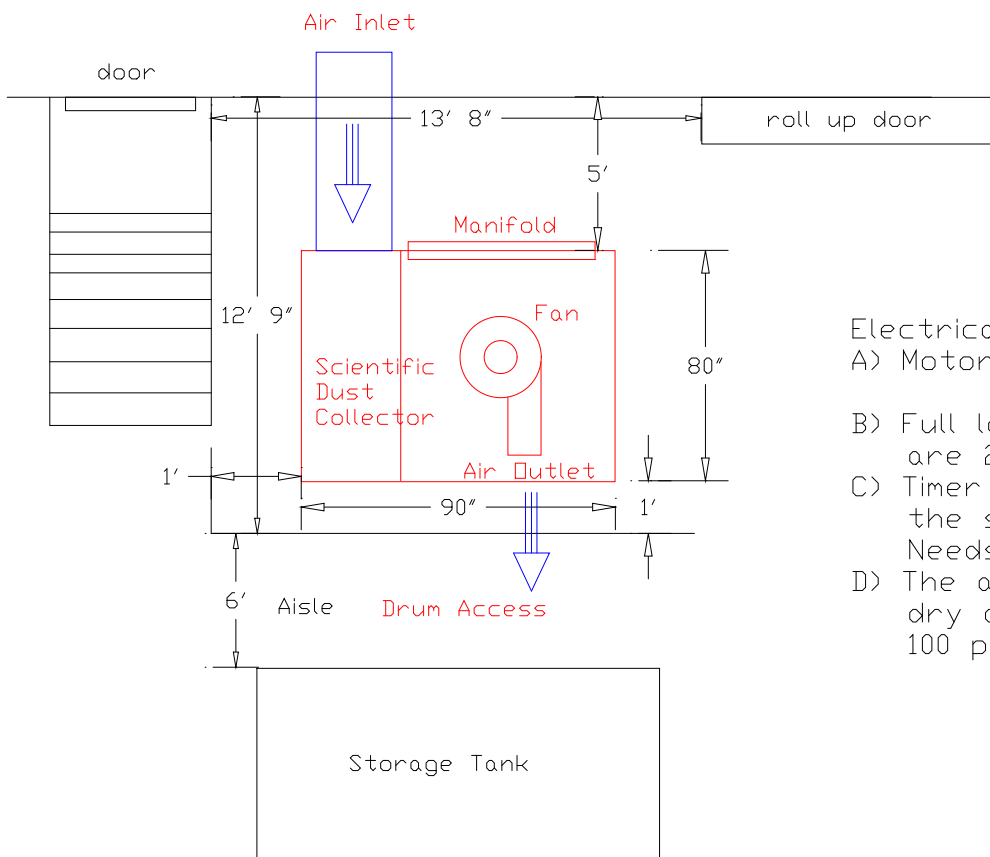

Electrical Notes:

- A) Motor: 15HP 460 volts
3 Phase TEFC
- B) Full load amps at 460 volts are 22amps
- C) Timer Board (controls when the solenoid valves pulse)
Needs 120 volts 1 phase
- D) The air supply must be clean, dry and oil free at 90 to 100 psig.

Industrial Air Quality	IAQ
102 AG DRIVE	
Youngsville, NC 27596	
P# 919-562-7181 F# 919-562-7182	
Project: Quantum Coatings	
Drawing: Dust collector	
Date: 11/21/08 Drawn by: RAV	
Sheet No: 1 of 2	