


Intercept Collector Duct Layout Plan View

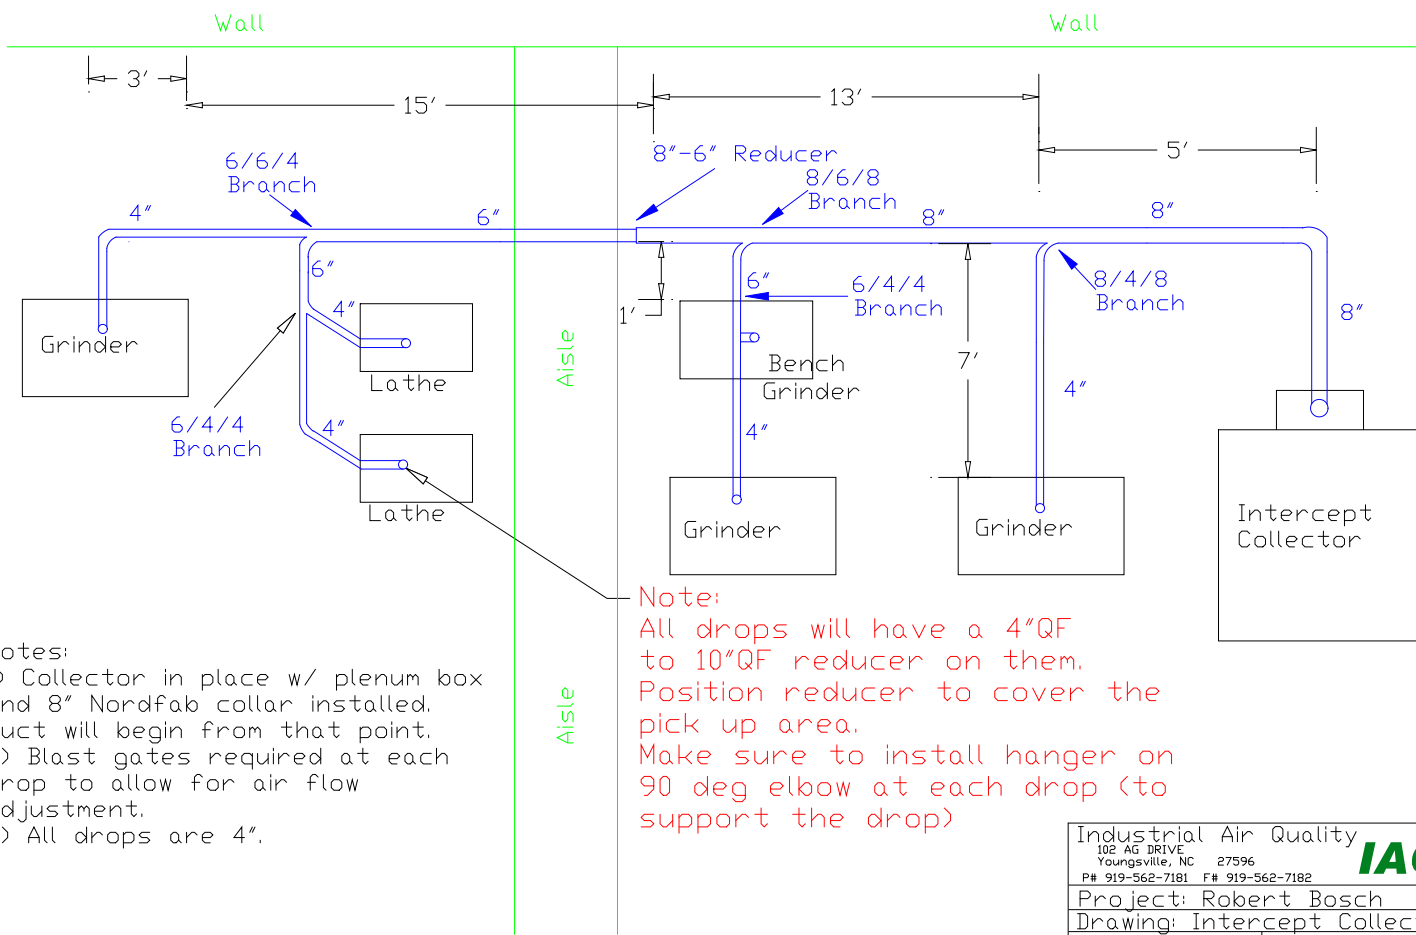

Note:
 All drops will have a 4"QF to 10"QF reducer on them.
 Position reducer to cover the pick up area.
 Make sure to install hanger on 90 deg elbow at each drop (<to support the drop)

- Notes:
- 1) Collector in place w/ plenum box and 8" Nordfab collar installed. Duct will begin from that point.
 - 2) Blast gates required at each drop to allow for air flow adjustment.
 - 3) All drops are 4".

Industrial Air Quality		IAQ
102 AG DRIVE Youngsville, NC 27596		
P# 919-562-7181 F# 919-562-7182		
Project: Robert Bosch		
Drawing: Intercept Collector		
Date: 8/15/07		Drawn by: DDJ
Revision Date:		