



# Ductwork layout for DDR 2000

Plan View

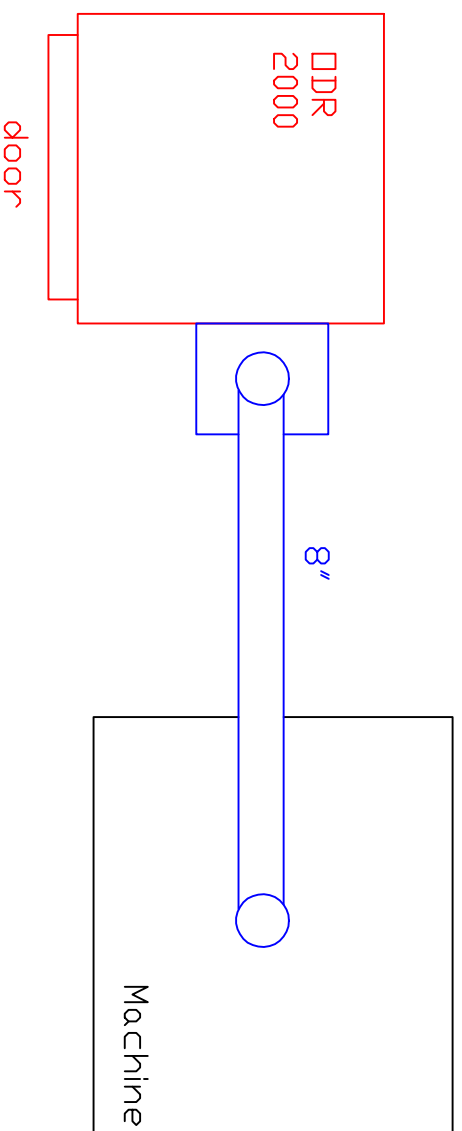

8" Pipe and Nipple  
 8" 90 deg elbow  
 10" to 15"  
 Side View  
 8" Butterfly damper (allows for air-flow adjustments)  
 Add Branch 8"/8"/8" here to allow for ambient air intake. Install 8" butterfly damper to control amount of ambient air.

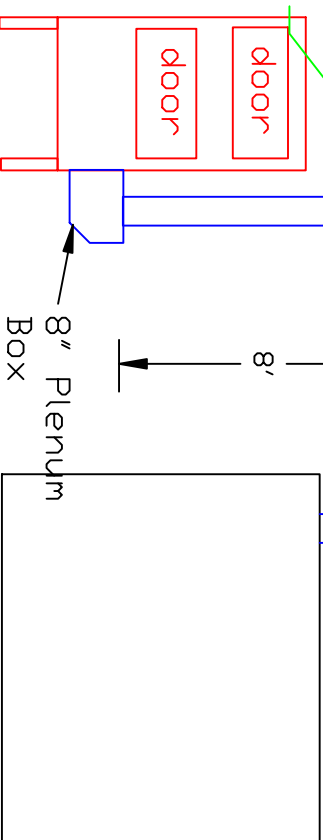

Industrial Air Quality
102 AG DRIVE
Toungsville, NC 27596
Ph 919-562-7181 F# 919-562-7182
Project: Fab Lab / Index
Drawings: DDR 2000 layout
Date: 8/27/10 Drawn by: RAV
Sheet No:

