


# Plan View of Ductwork Layout Head #3 - Intermediate Wash

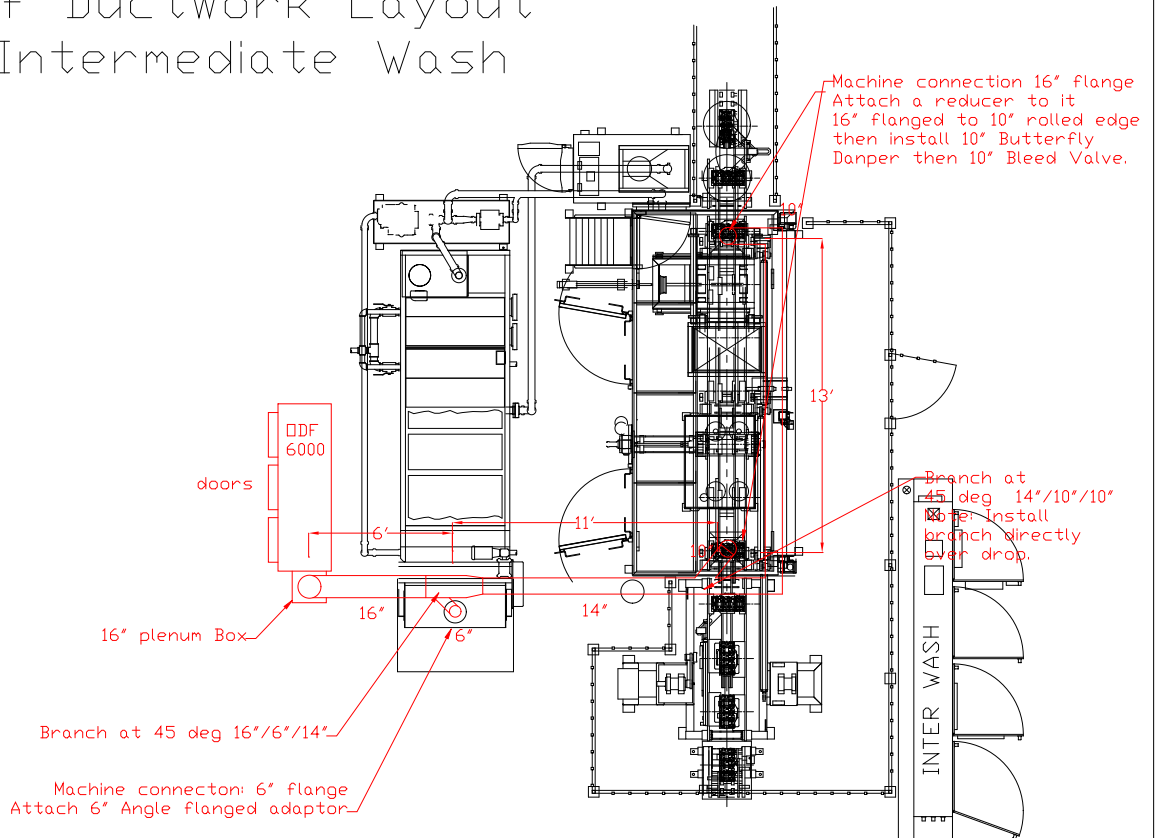

## Notes:

- A) Each drop will have a Butterfly damper for airflow adjustment.
- B) Each drop will have a Bleed in valve to allow for balancing.
- C) DDF 6000F has 3 - 3.5HP 460volt 3Phase motors. Full load amps are 4.6 amps each.
- D) Drain line: P-Trap made of  $\frac{3}{4}$ " Galvanized with ball valve and unions. IAQ to provide. Honda to provide piping to sump.

|                                           |               |            |
|-------------------------------------------|---------------|------------|
| Industrial Air Quality                    |               | <b>IAQ</b> |
| 95 Cypress Drive<br>Youngsville, NC 27596 |               |            |
| P# 919-562-7181 F# 919-562-7182           |               |            |
| Project: Honda Canada                     |               |            |
| Drawing: Head #3 Inter Wash               |               |            |
| 3/12/08                                   | Drawn by: RAV |            |
| Sheet No:                                 |               |            |