


# Plan View of Ductwork Layout

## Head #6 - Final Washer

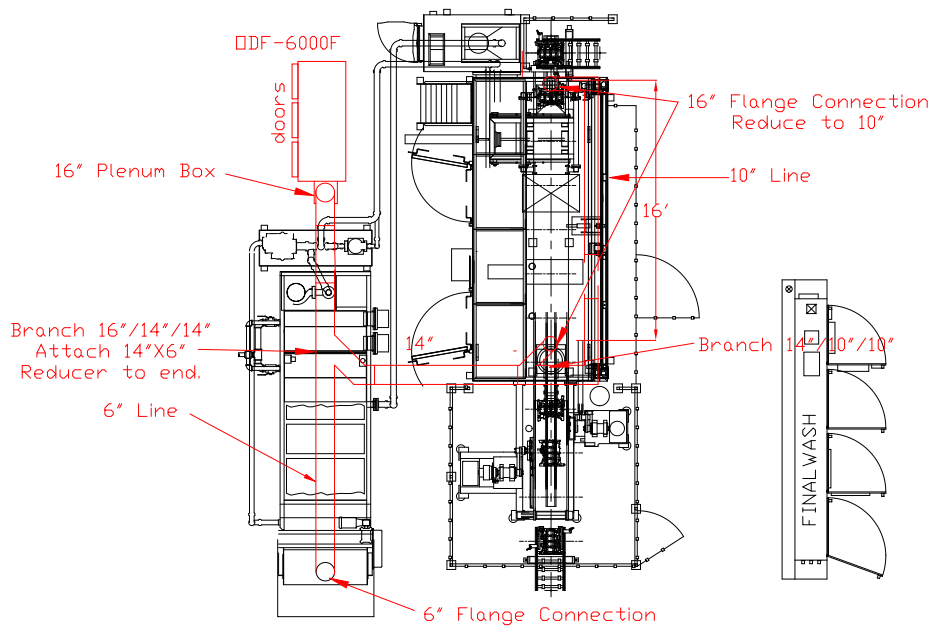

**Notes:**

- A) Each drop will have a Butterfly damper for airflow adjustment.
- B) Each drop will have a Bleed in valve to allow for balancing.
- C) DDF 6000F has 3 - 3.5HP 460volt 3Phase motors. Full load amps are 4.6amps each.
- D) Drain line: P-Trap made of 3/4 Galvanized with ball valve and unions. IAQ to provide. Honda to provide piping to sump.

Industrial Air Quality	
95 Cypress Drive Youngsville, NC 27596	
P# 919-562-7181 F# 919-562-7182	
Project: Honda Canada	
Drawing: Head #6 Final Washer	
Date: 03/29/08	Drawn by: W/WB
Sheet No:	