Johnston Community College
Welding Booth Duct Layout

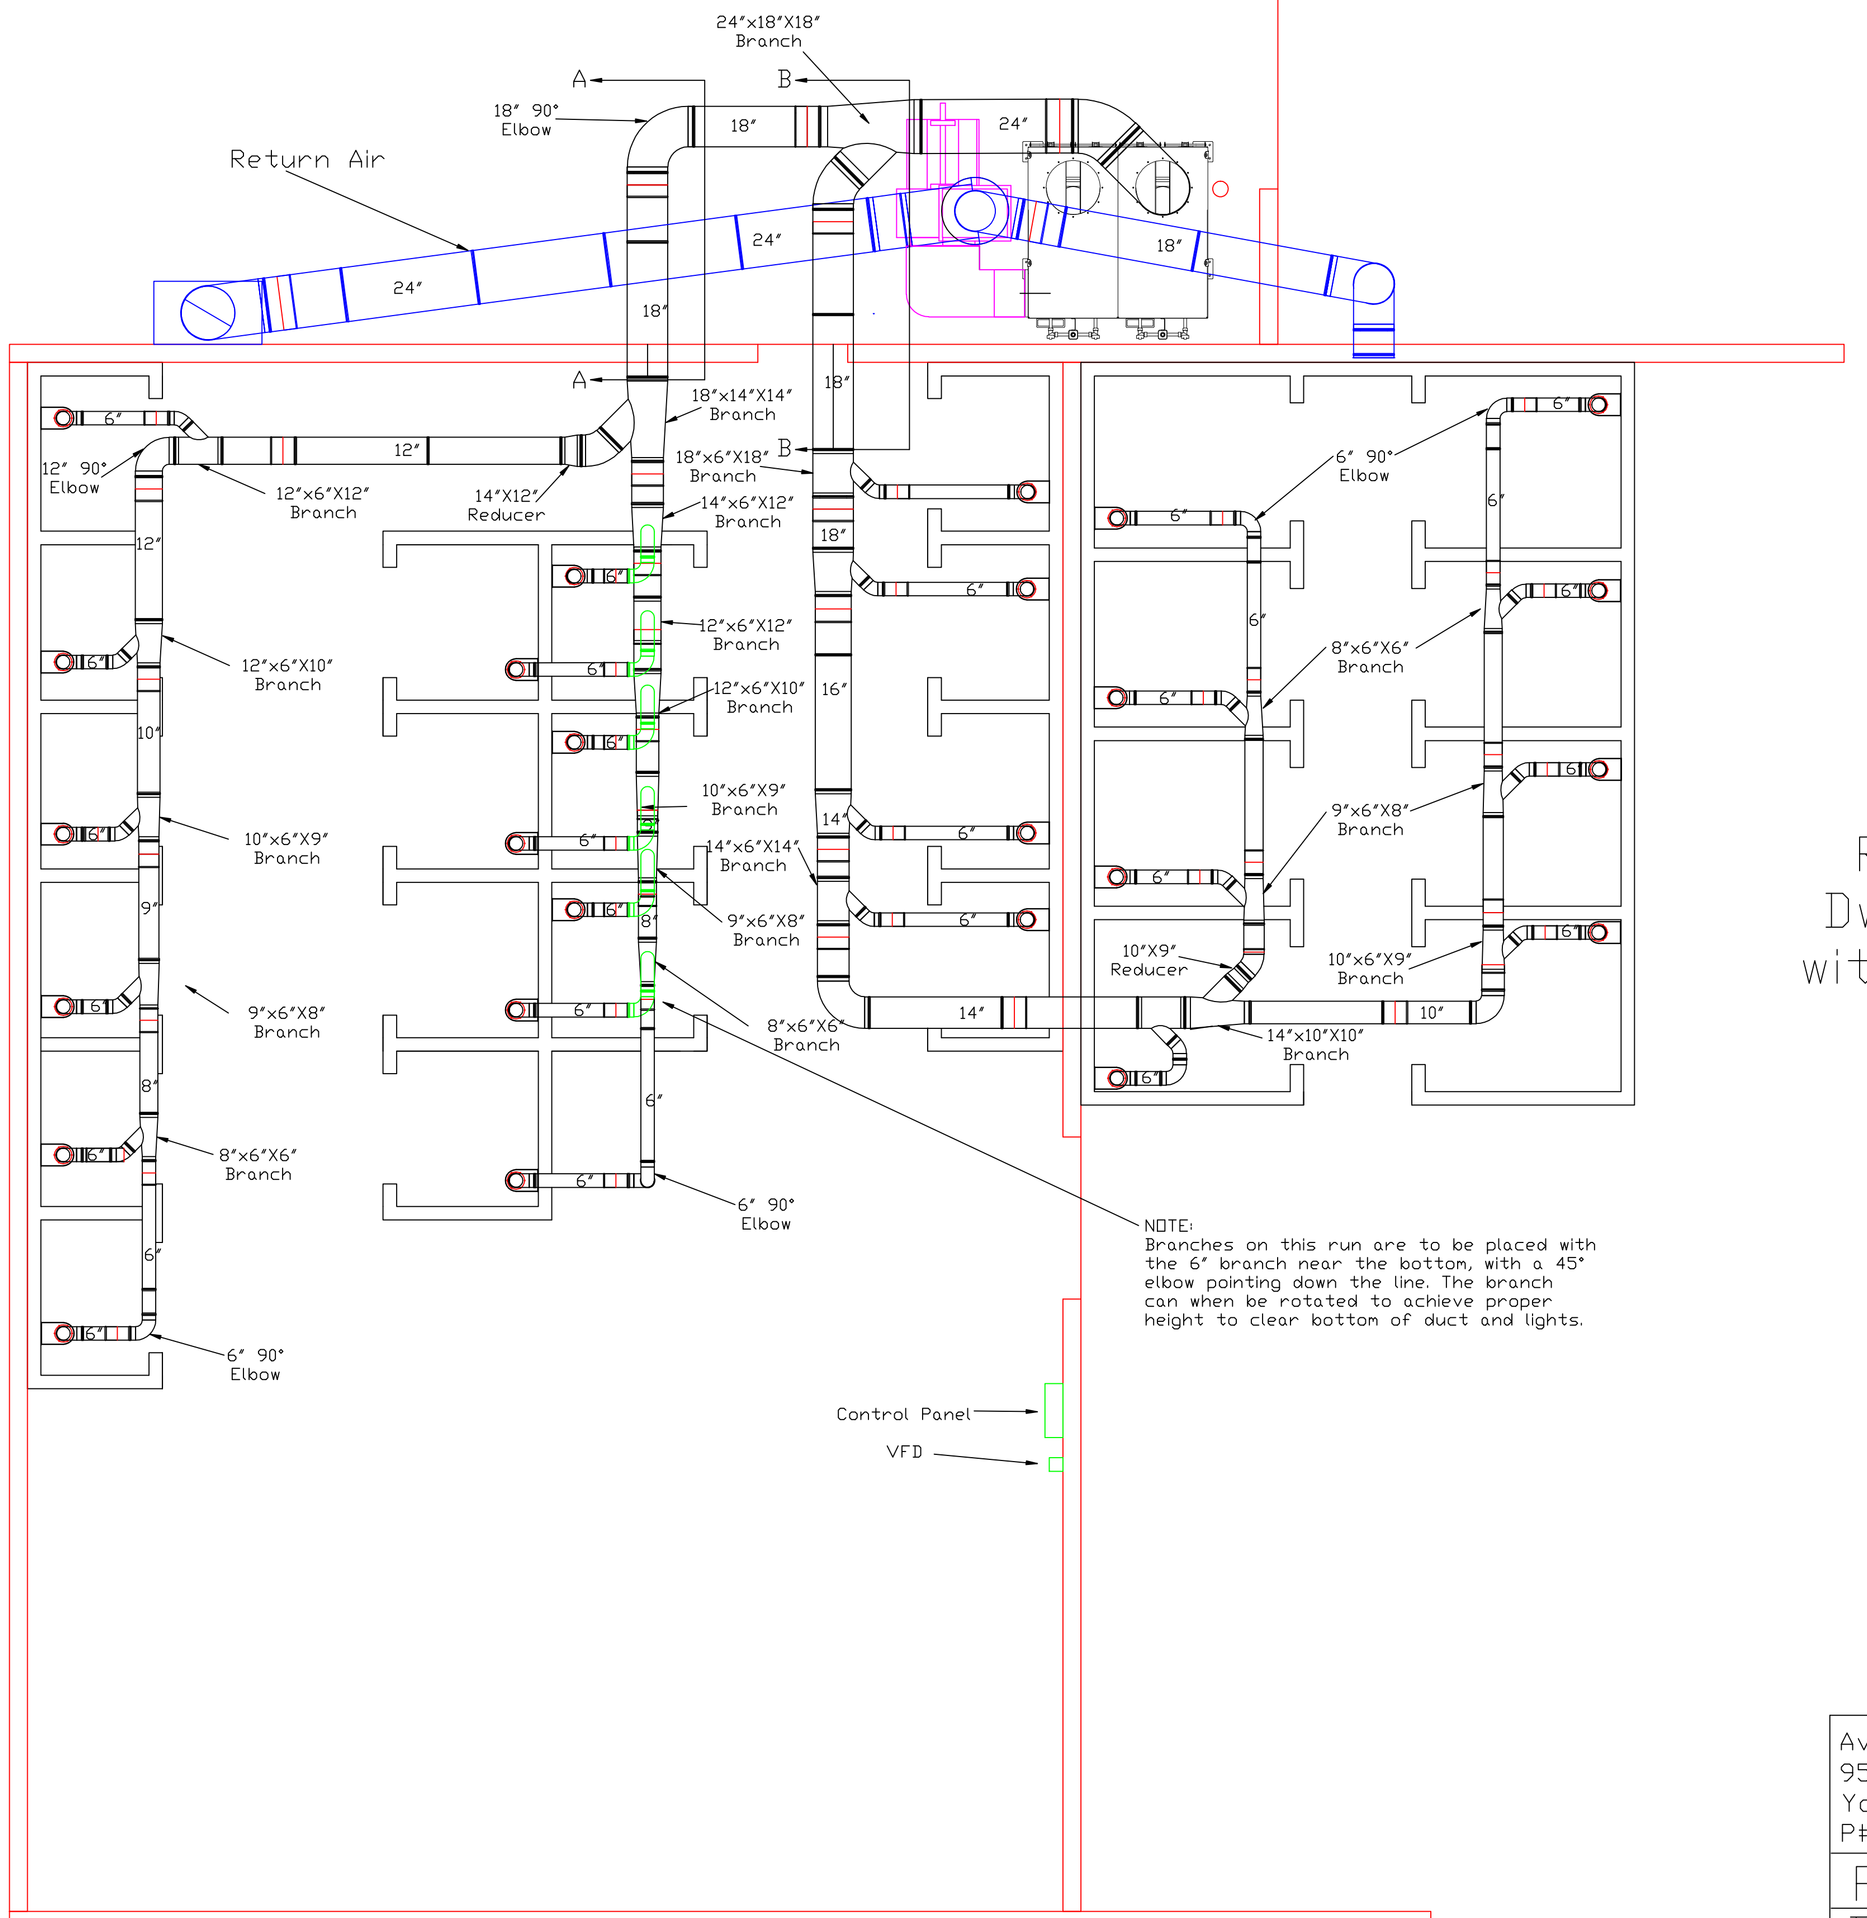

Plan View

Notes:

Collector

ACT 3-24, 24 cartridges
Reverse Pulse Cleaning System
Dwyer pulse control timer board with built-in digital pressure gage
Goyen diaphragm and solenoid valves

FAN

Twin City Fan Model BCS 270
15,200 CFM @ 12"
40HP, 480Volt, 53 FLA
Belt Drive

Avani Environmental Intl.
95 Cypress Drive
Youngsville, NC 27596
P# 919-570-2862 F# 919-570-2863

Avani

Project: Johnston Community College	
Drawing: Welding Booth Duct Layout	
Date: 6/22/12	Drawn by: WWB
Sheet No: 1 of 2	Rev.: 0