


Medtronic Building #2 System C

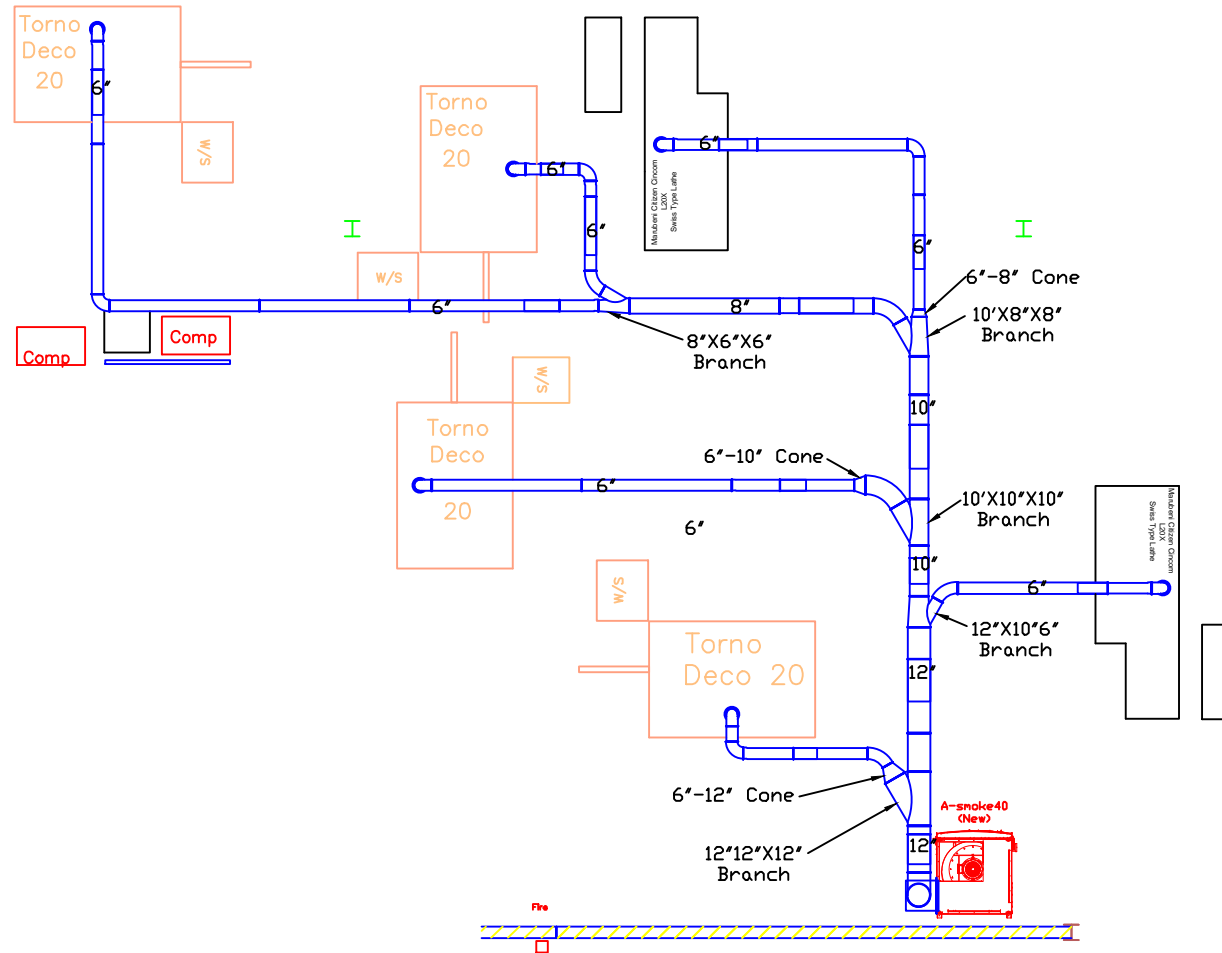

Notes:

- 1) A*smoke40 Standard Unit
- 2) All 6 drops have throttle valves
- 3) All 6 drops have fire dampers
- 4) All drops are 6"

PRELIMINARY

This product has not been tested for seismic calculations. Any Customer requested, or caused changes or deviations from the approved drawing that effect T&M will require a change order.

Avani Environmental Intl. Inc. 95 Cypress Drive Youngsville, NC 27596 P# 919-570-2862 F# 919-570-2863		<h1 style="font-size: 2em; color: blue;">Avani</h1>
Project: Medtronic Bldg. 2 Drawing: System C		
Date: 6/15/15		Drawn by: WWB
Sheet No: 1		Rev 0