


# Medtronic Building #2 System D

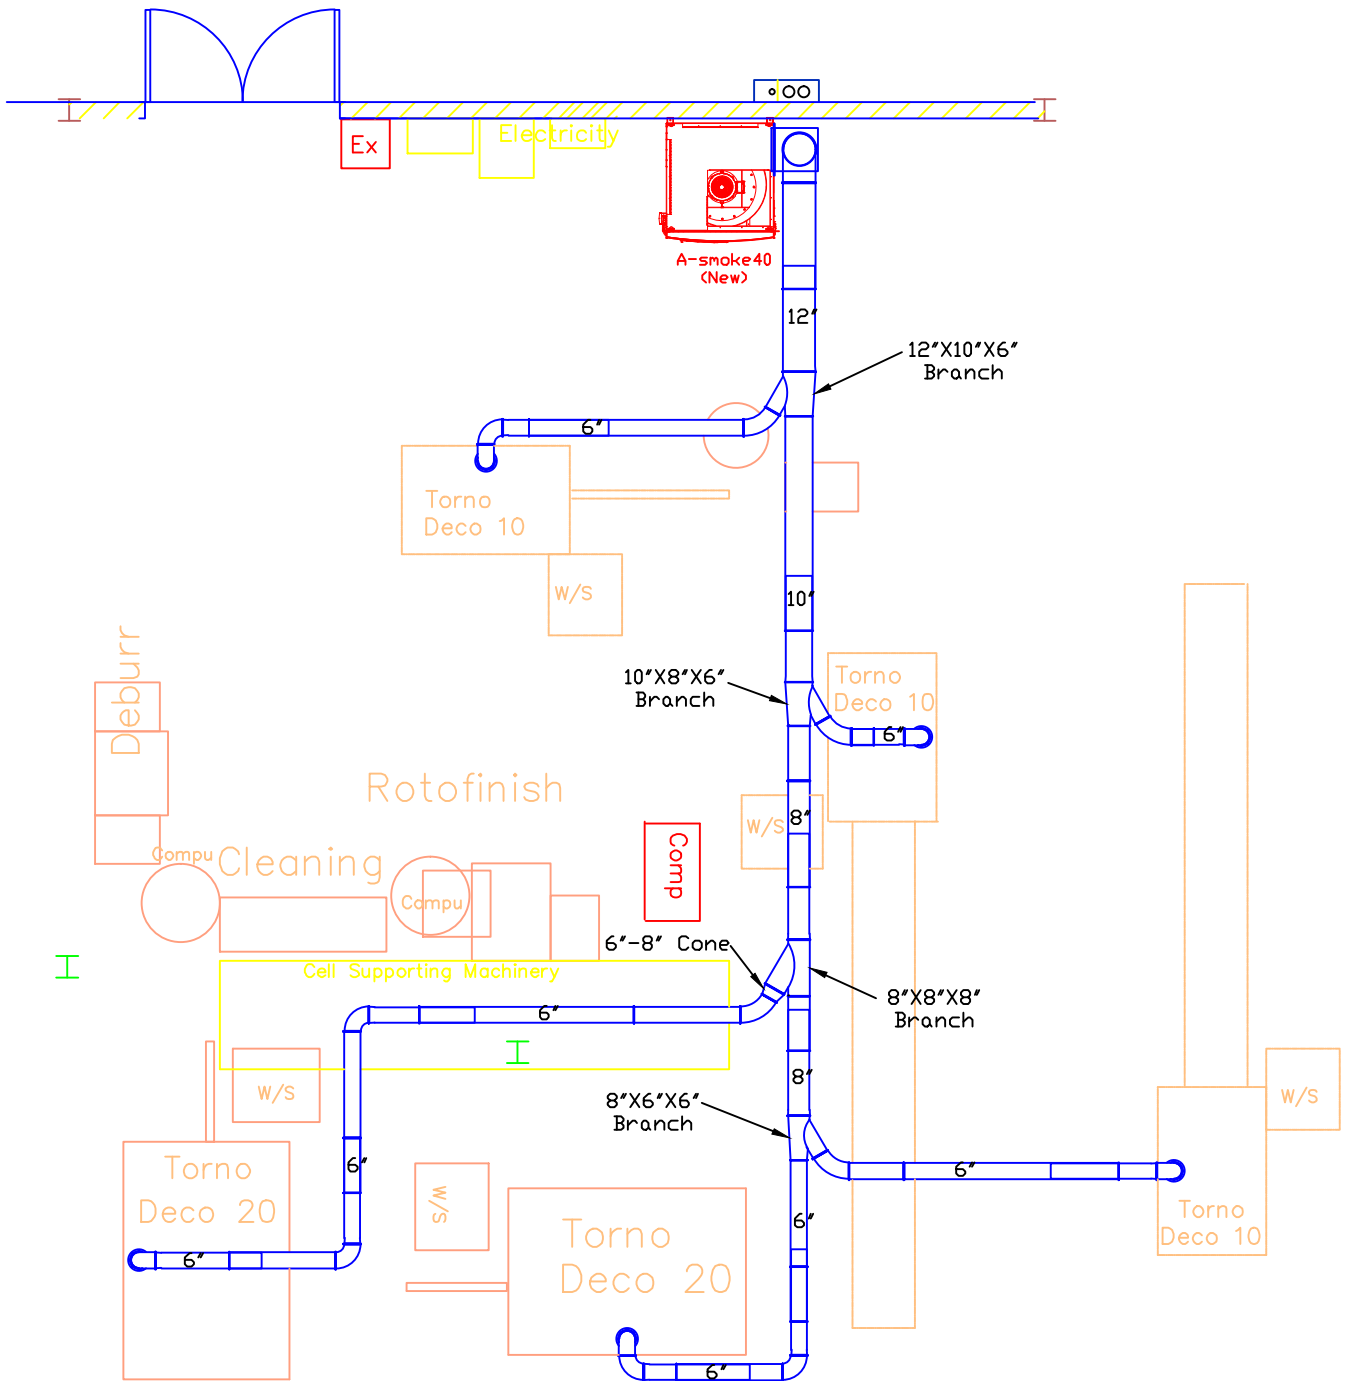

**Notes:**

- 1) A\*smoke40 Standard Unit
- 2) All 5 drops have throttle valves
- 3) All 5 drops have fire dampers
- 4) All drops are 6"

**PRELIMINARY**

This product has not been tested for seismic calculations.

Any Customer requested, or caused changes or deviations from the approved drawing that effect T&M will require a change order.

Avani Environmental  
95 Cypress Drive  
Youngsville, NC 27596  
P# 919-570-2862 F# 919-570-2863

**Avani**

Project: Medtronic Bldg. 2	
Drawing: System D	
Date: 6/15/15	Drawn by: WWB
Sheet No: 1	Rev.: 0