


# Medtronic Building #2 System E

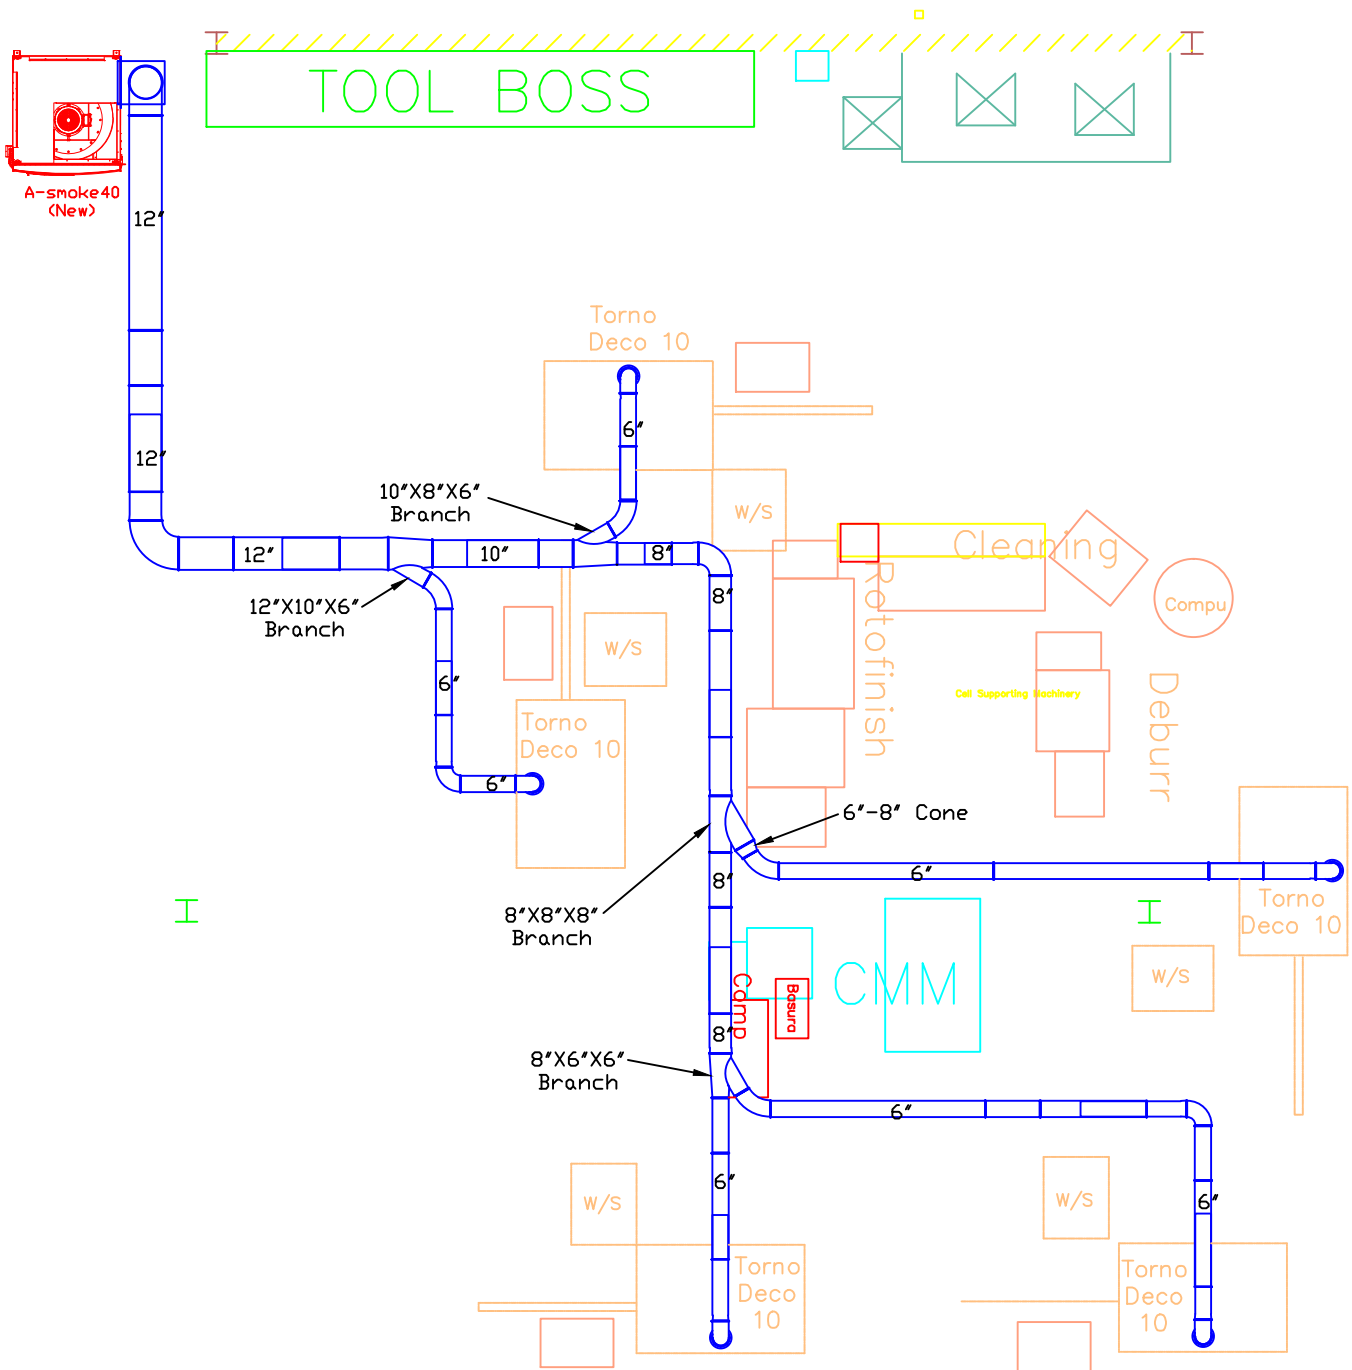

## Notes:

- 1) A\*smoke40 Standard Unit
- 2) All 5 drops have throttle valves
- 3) All 5 drops have fire dampers
- 4) All drops are 6"

## PRELIMINARY

This product has not been tested for seismic calculations.

Any Customer requested, or caused changes or deviations from the approved drawing that effect T&M will require a change order.

Avani Environmental  
95 Cypress Drive  
Youngsville, NC 27596  
P# 919-570-2862 F# 919-570-2863

# Avani

Project: Medtronic Bldg. 2  
Drawing: System E  
Date: 6/12/15 Drawn by: WWB  
Sheet No: 1 Rev.: 0