

Stand Drawing for ODR 12000 and Fan


Side View

Absolent Stand is 86" Deep
Exhaust Fan Stand is 36" Deep


Use 4" Square Tubing for legs
and center support.

Add Gussets in all corners
for support

Use $\frac{1}{4}$ " Plate Steel for each
foot pad with $\frac{7}{16}$ " diameter holes


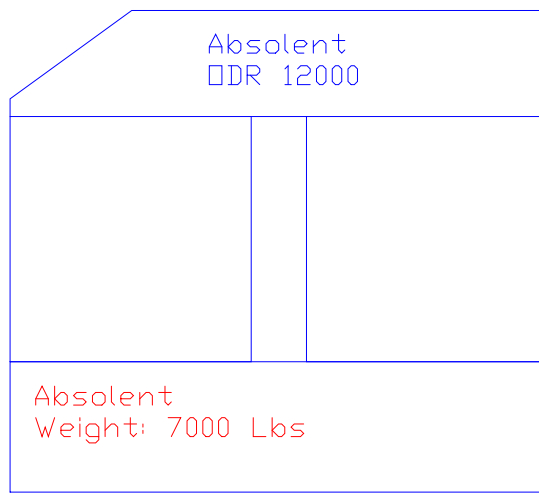


Ductwork

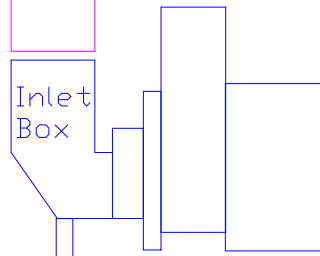

Exhaust Fan
with Inlet Box
Weight: 1800 Lbs

Exhaust
Fan

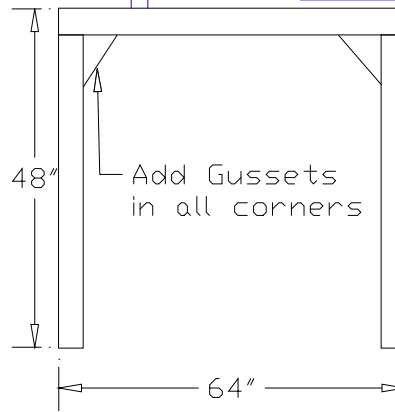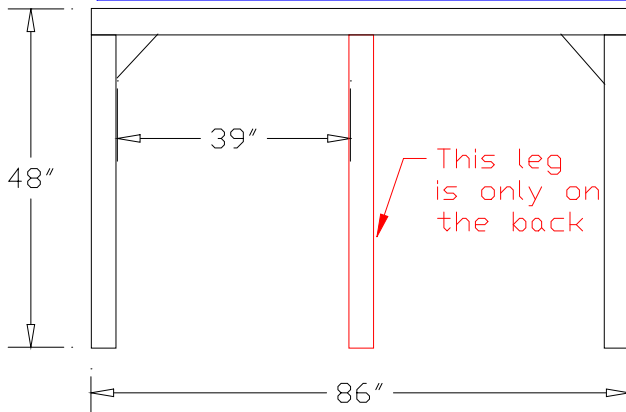

Note: All legs on
both stands are
4" square tubing
thick wall

Industrial Air Quality		IAQ
102 AG DRIVE Youngsville, NC 27596		
P# 919-562-7181	F# 919-562-7182	
Project: Paulo Products		
Drawing: Stand Drawing		
Date: 3/30/09	Drawn by: RAV	
Sheet No:		