


Radial Lines Machine Connection Detail

Side View

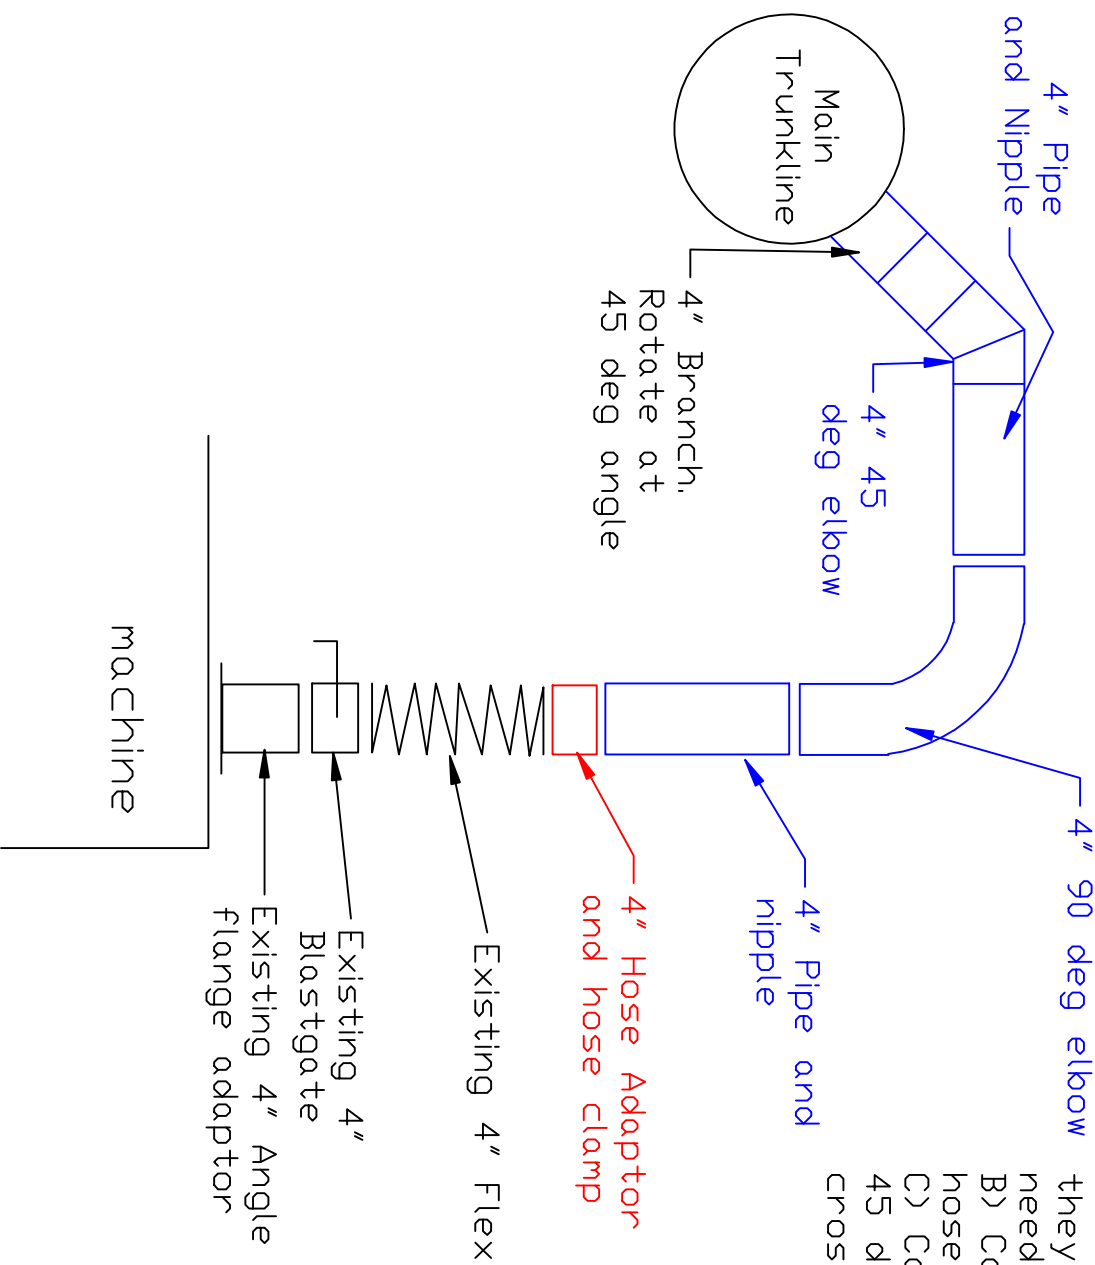

- Notes:
- A) Leave existing 4" flex, blastgate and adaptor, so they can remove top as needed.
 - B) Connect to flex with 4" hose adaptor.
 - C) Come off of branch at 45 deg angle to prevent cross contamination.

Industrial Air Quality
102 AG DRIVE
Toungesville, NC 27596
PH 919-562-7181 F# 919-562-7182
Project: Timken - Test Lab
Drawing: Radial drop detail
Date: 10/19/09 Drawn by: RAV
Sheet No: 1 of 2

