


Collector / Fan Layout Plan View

Note:
 A) The return air ductwork will run vertically from the fan outlet then over and into the building.
 B) Pad size is 9' x 64'

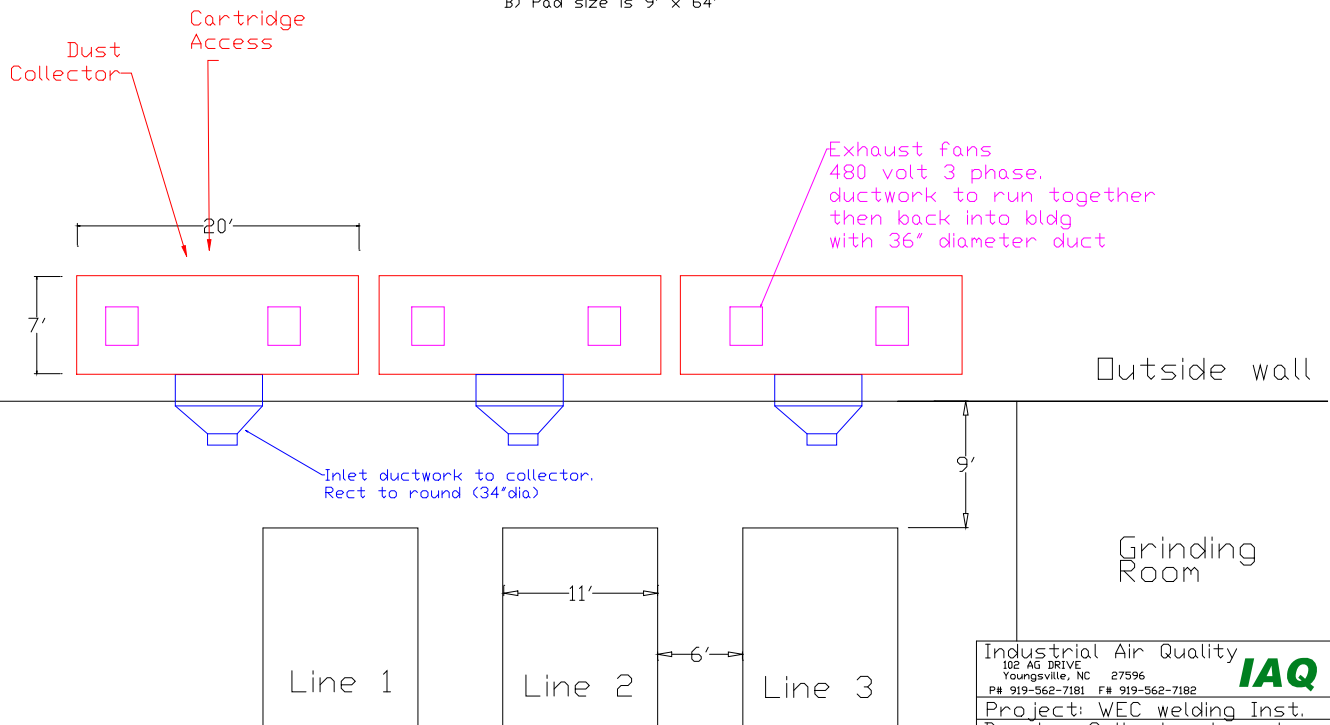

Class Room

Line 1

Line 2
11'


Line 3
6'

Grinding Room

Industrial Air Quality	IAQ
102 AG DRIVE	27596
Youngsville, NC	
PH 919-562-7181	FX 919-562-7182
Project: WEC welding Inst.	
Drawing: Collector layout	
Date: 2/23/09 Drawn by: RAV	
Sheet No:	

Collector / Fan Layout Plan View

Note:
 A) The return air ductwork will run vertically from the fan outlet then over and into the building.
 B) Pad size is 9' x 64'

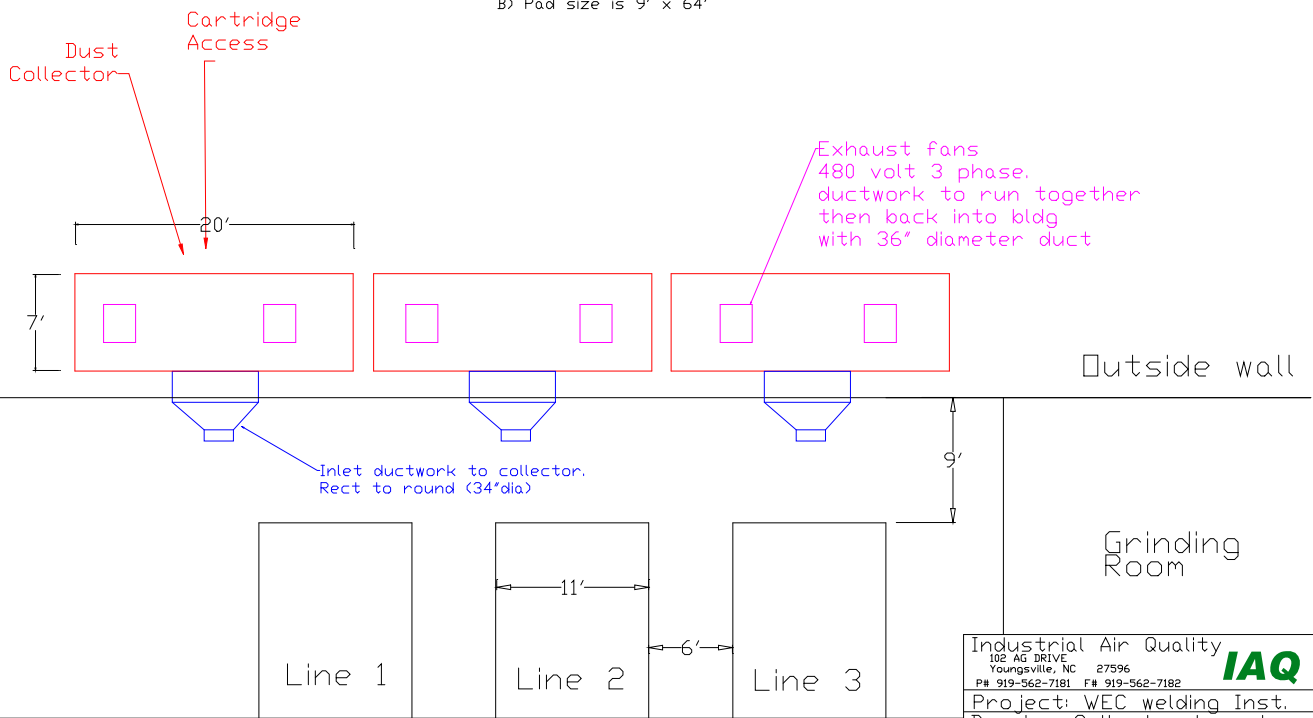


Industrial Air Quality	IAQ
102 AG DRIVE Youngsville, NC 27596 PH 919-562-7181 FH 919-562-7182	
Project: WEC welding Inst.	
Drawing: Collector layout	
Date: 2/23/09 Drawn by: RAV	
Sheet No:	

Collector / Fan Layout

Plan View

Note:
 A) The return air ductwork will run vertically from the fan outlet then over and into the building.
 B) Pad size is 9' x 64'

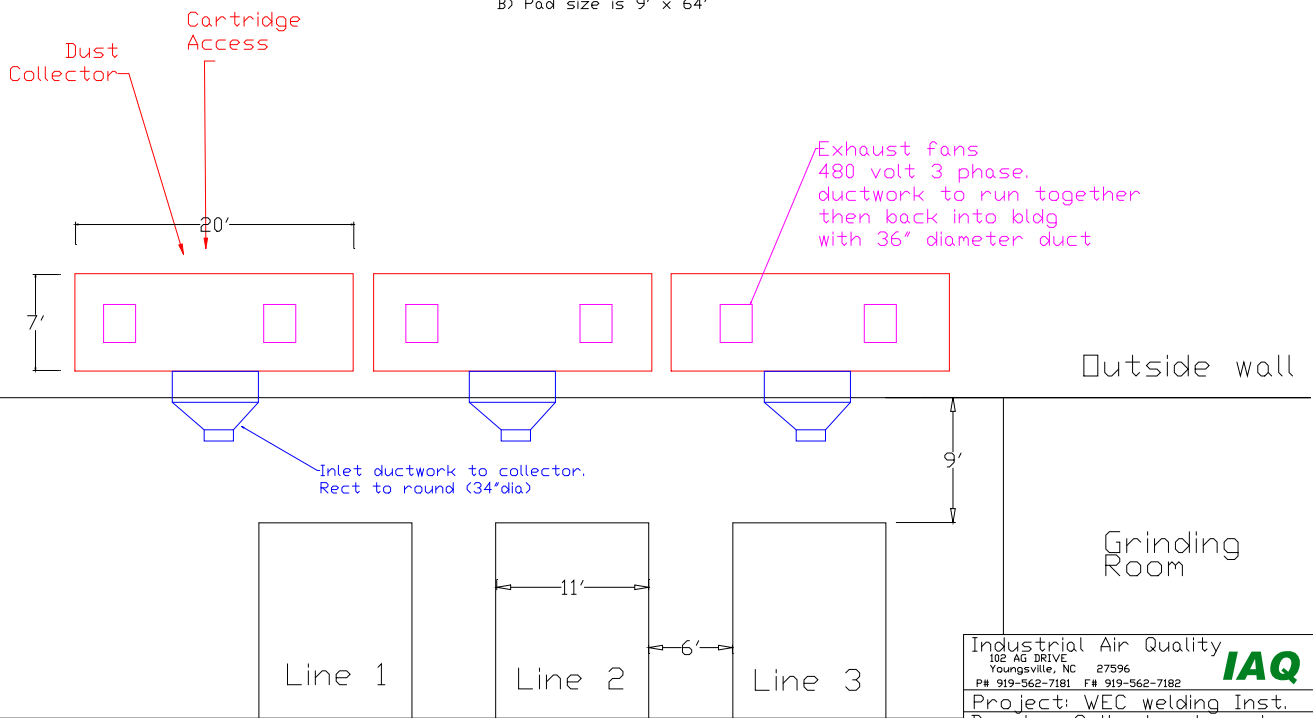

Industrial Air Quality	IAQ
102 AG DRIVE Youngsville, NC 27596 PH 919-562-7181 FH 919-562-7182	
Project: WEC welding Inst.	
Drawing: Collector layout	
Date: 2/23/09 Drawn by: RAV	
Sheet No:	