Ductwork Layout for Fan A

Plan View

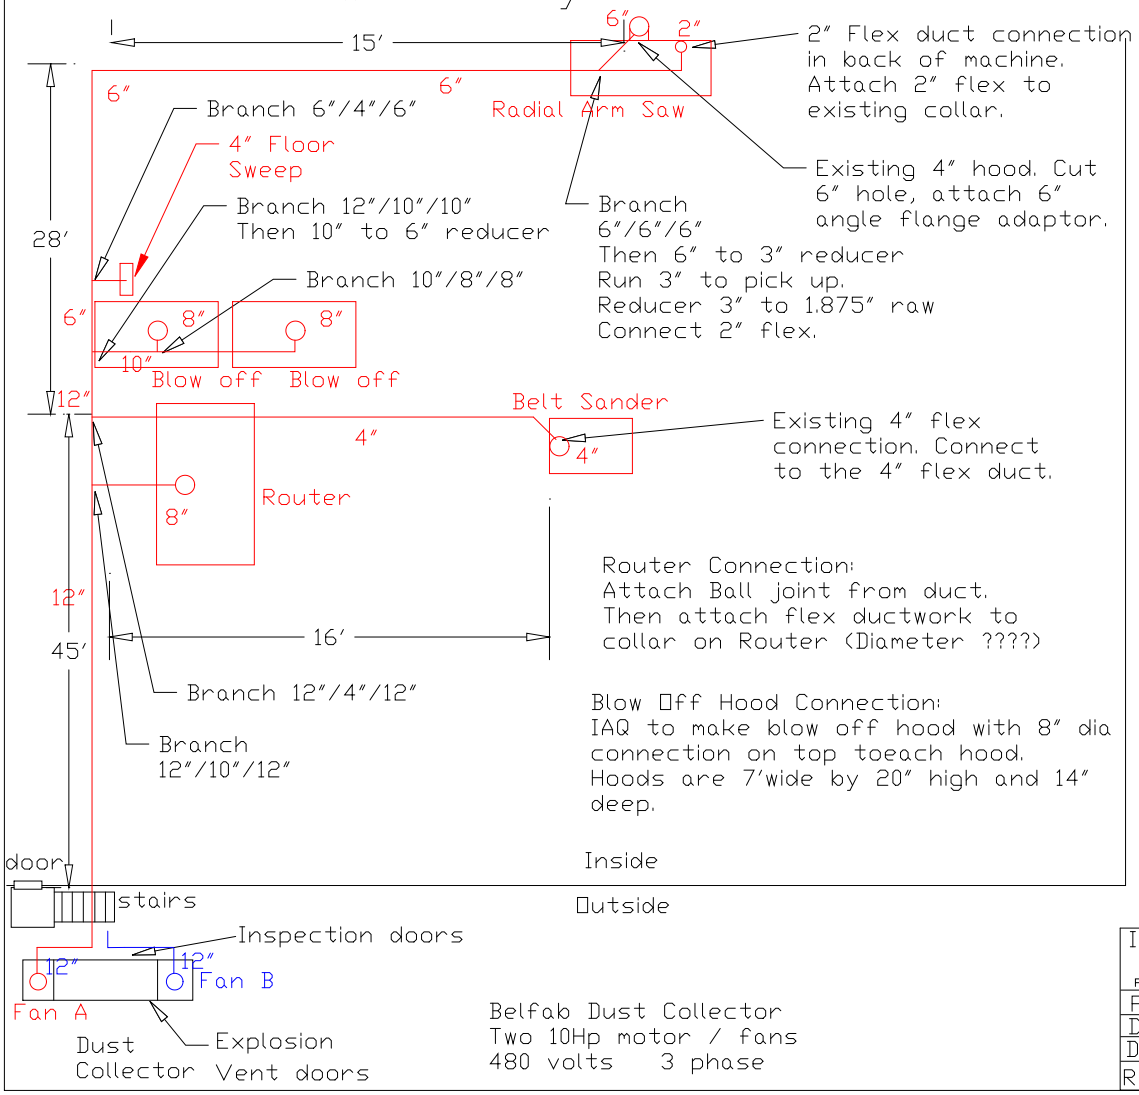

Notes:
A) Bottom of ductwork off of floor is 10′ 6″
B) The Router and Blow off hoods wil have an automatice blastgate so one will be open while the other is closed.
C) All other machines will have a manual blastgate for air flow adjustment.

Belfab Dust Collector
Two 10Hp motor / fans
480 volts 3 phase

Industrial Air Quality
102 AG DRIVE
Youngsville, NC 27596
P# 919-562-7181 F# 919-562-7182
IAQ

Project: WINC	
Drawing: Ductwork layout	
Date: 9/15/08	Drawn by: RAV
Reveision: 9/30/08	