Plan View

Ductwork Layout for Fan B

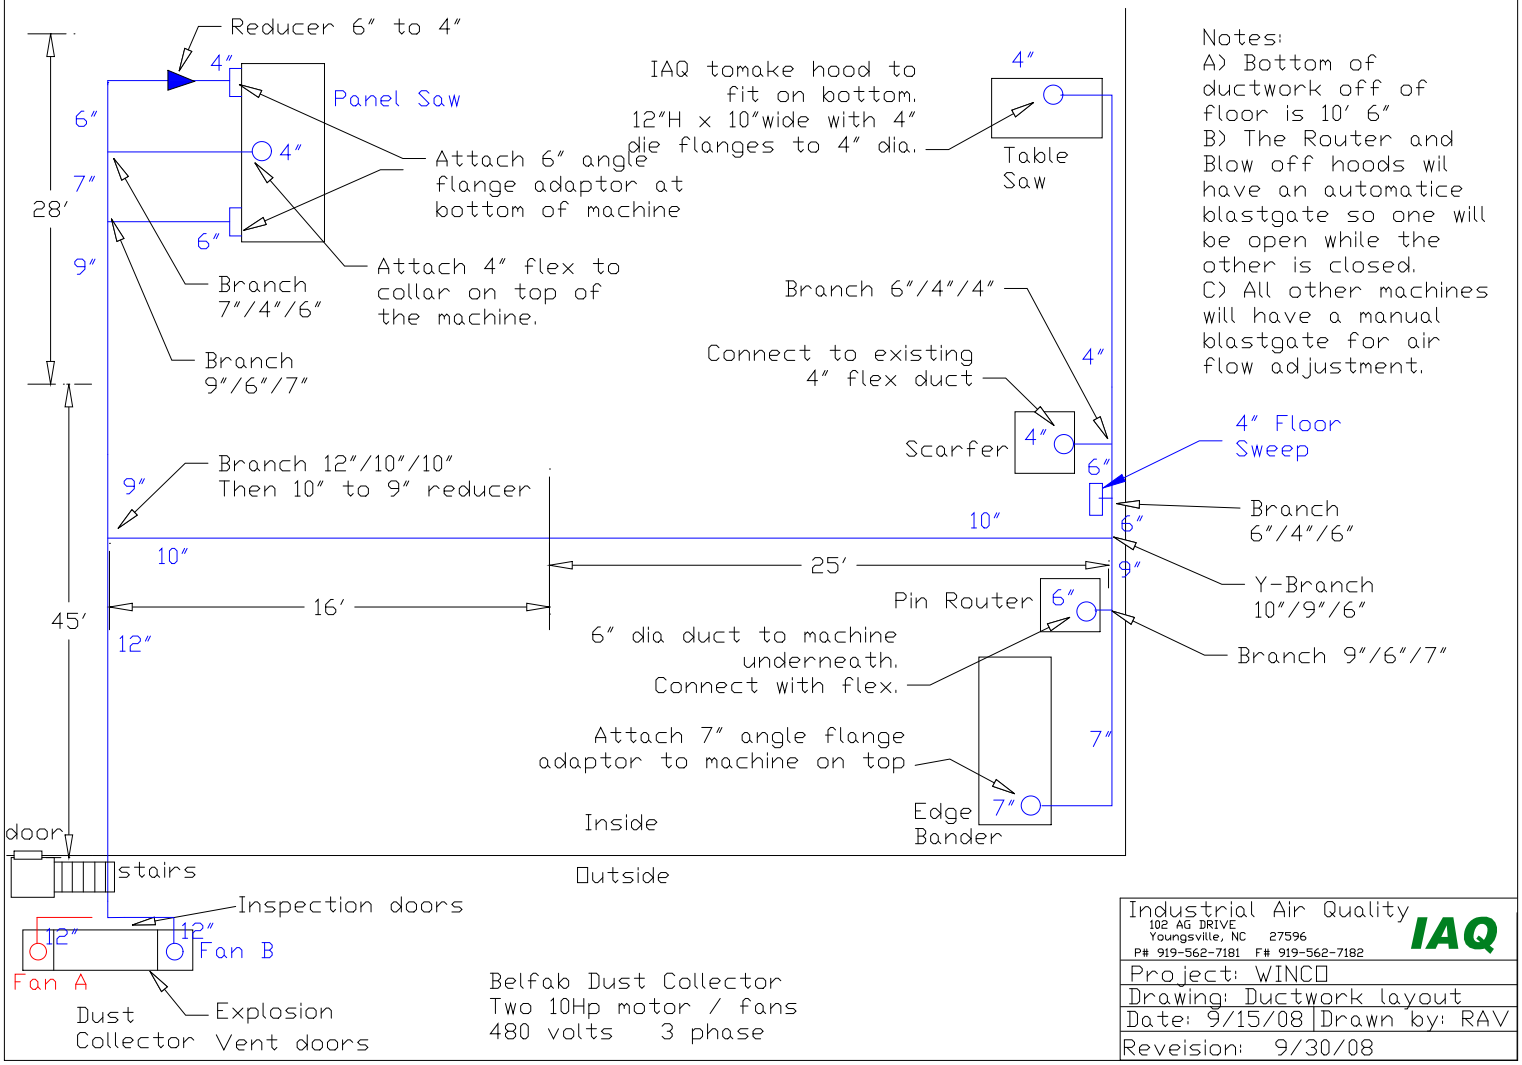

Belfab Dust Collector
Two 10Hp motor / fans
480 volts 3 phase

Notes:
A) Bottom of ductwork off of floor is 10' 6"
B) The Router and Blow off hoods wil have an automatice blastgate so one will be open while the other is closed.
C) All other machines will have a manual blastgate for air flow adjustment.

Industrial Air Quality
102 AG DRIVE
Youngsville, NC 27596
P# 919-562-7181 F# 919-562-7182
IAQ

Project: WINC□	
Drawing: Ductwork layout	
Date: 9/15/08	Drawn by: RAV
Reveision: 9/30/08	