


# Duct Layout for Axial Fan

Plan View

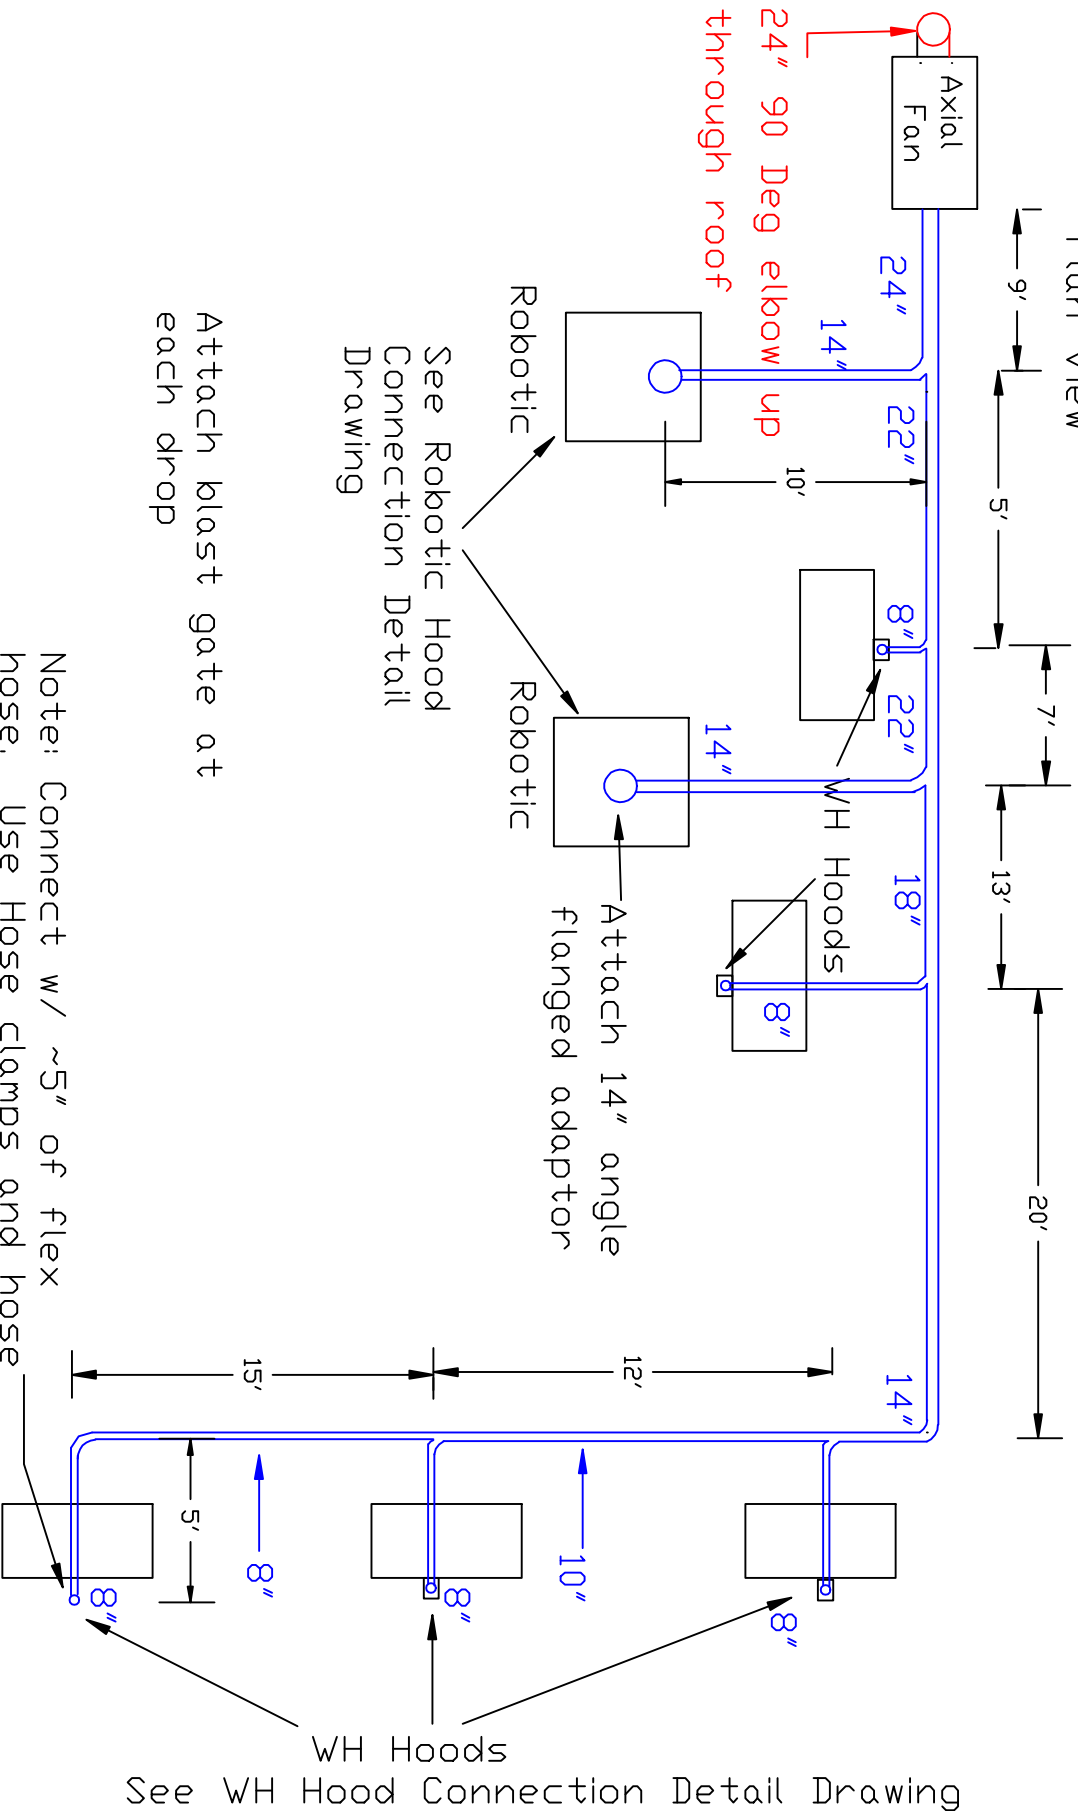

Attach blast gate at each drop

Note: Connect w/ ~5" of flex hose. Use Hose clamps and hose adaptor for each.

See WH Hood Connection Detail Drawing

<p>Industrial Air Quality                  102 AG DRIVE                  Youngsville, NC 27596                  PH 919-562-7181 F# 919-562-7182</p>	<p>Project: Winco, Decolo, FL                  Drawing: Duct Layout                  Date: 4/03/07 Drawn by: DDJ                  Revision Date: 6/23/07</p>
---	--

