


Ductwork Layout for Mori Seikis

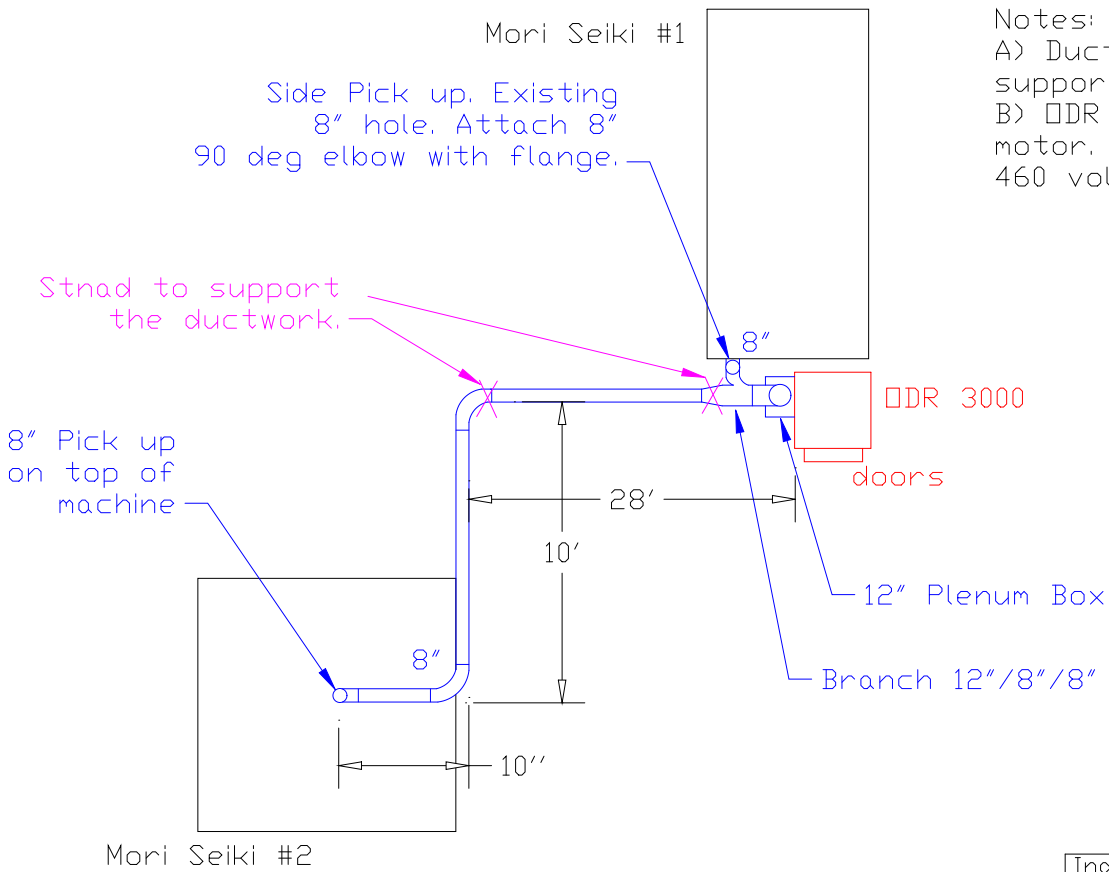

Notes:

- A) Ductwork to be supported from stands
- B) DDR 3000 has a 10HP motor. Full load amps at 460 volts is 14.4

Industrial Air Quality		IAQ
102 AG DRIVE		
Youngsville, NC 27596		
P# 919-562-7181	F# 919-562-7182	
Project: Vaughan Company		
Drawing: ductwork layout		
Date: 2/18/09	Drawn by: RAV	
Sheet No:		