


# Allegheny Ludlum Corp. Weld Table System Duct Work

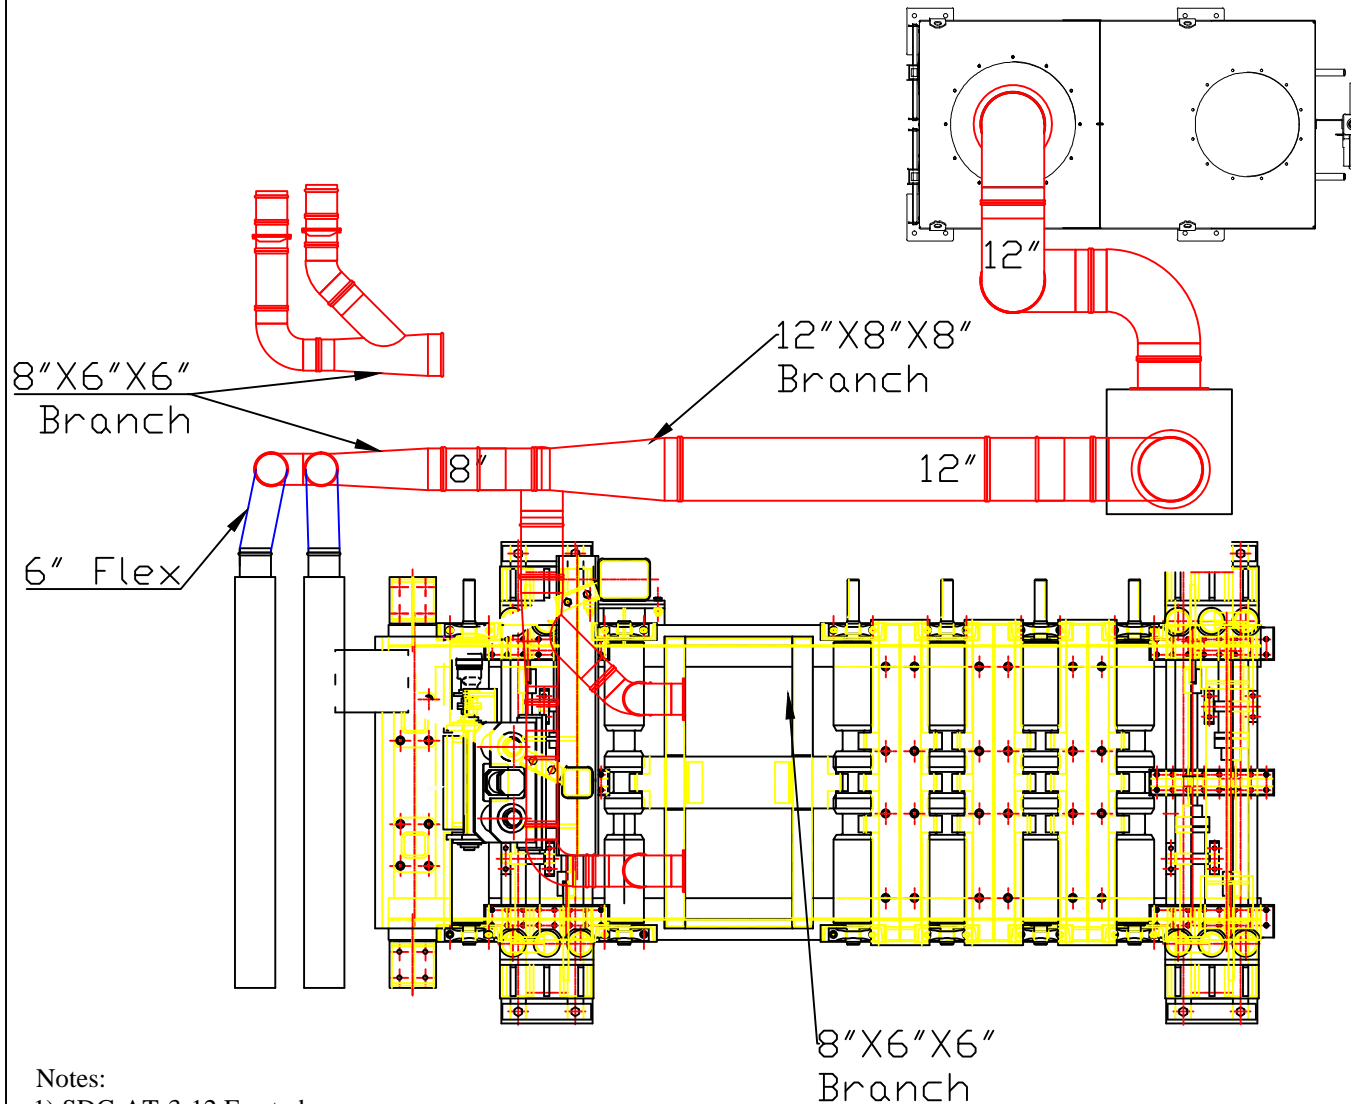

- Notes:
- 1) SDC-AT-3-12 Fan to be mounted on side of Collector
  - 2) All drops to have blast gates

Sales Order # 22839

FINAL

This product has not been tested for seismic calculations.

Any Customer requested, or caused changes or deviations from the approved drawing that effect T&M will require a change order.

Avani Environmental Intl. Inc.  
95 Cypress Drive  
Youngsville, NC 27596  
P# 919-570-2862 F# 919-570-2863

**Avani**

Project: ATI / Air Gas	
Drawing: Weld Table Ducting	
Date: 6/18/15	Drawn by: WWB
Sheet No: 1	Rev 0