


Allegheny Ludlum Corp. Weld Table System Duct Work

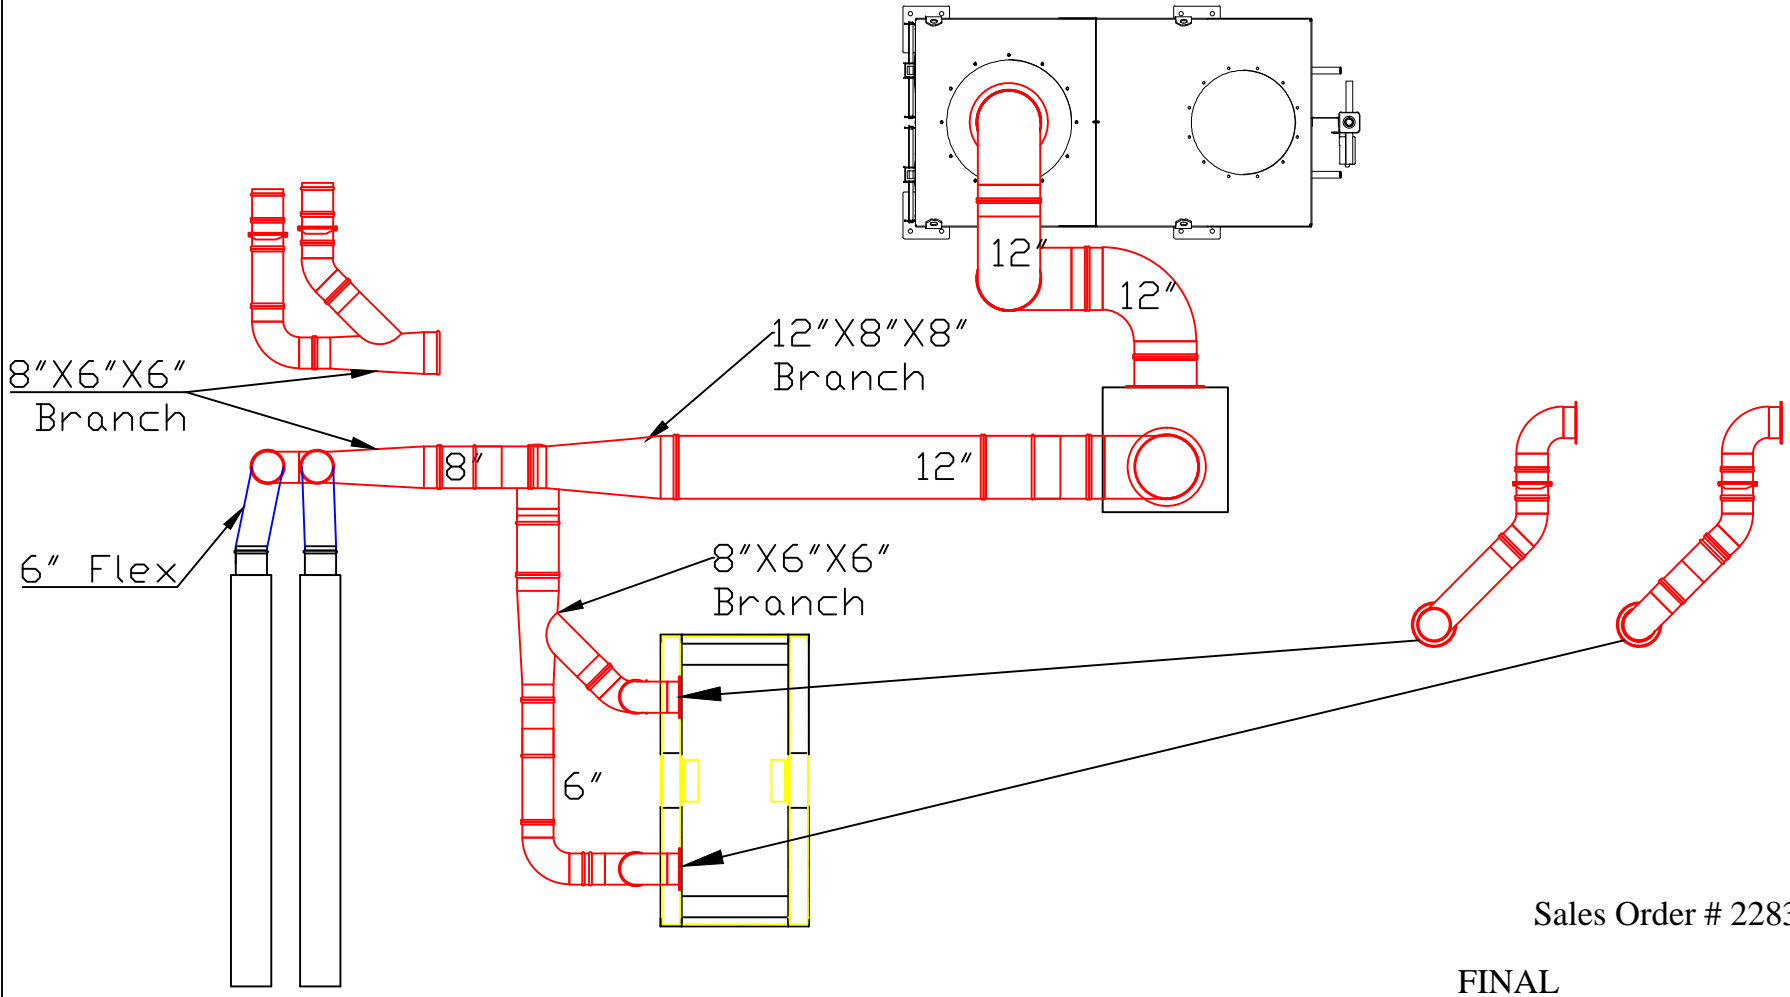

- Notes:
- 1) SDC-AT-3-12 Fan to be mounted on side of Collector
 - 2) All drops to have blast gates

Sales Order # 22839

FINAL

This product has not been tested for seismic calculations. Any Customer requested, or caused changes or deviations from the approved drawing that effect T&M will require a change order.

Avani Environmental Intl. Inc. 95 Cypress Drive Youngsville, NC 27596 P# 919-570-2862 F# 919-570-2863		<h2 style="margin: 0;">Avani</h2>
Project: ATI / Air Gas		
Drawing: Weld Table Ducting		
Date: 6/18/15	Drawn by: WWB	
Sheet No: 2	Rev 0	