


Tool Room Ducting #3

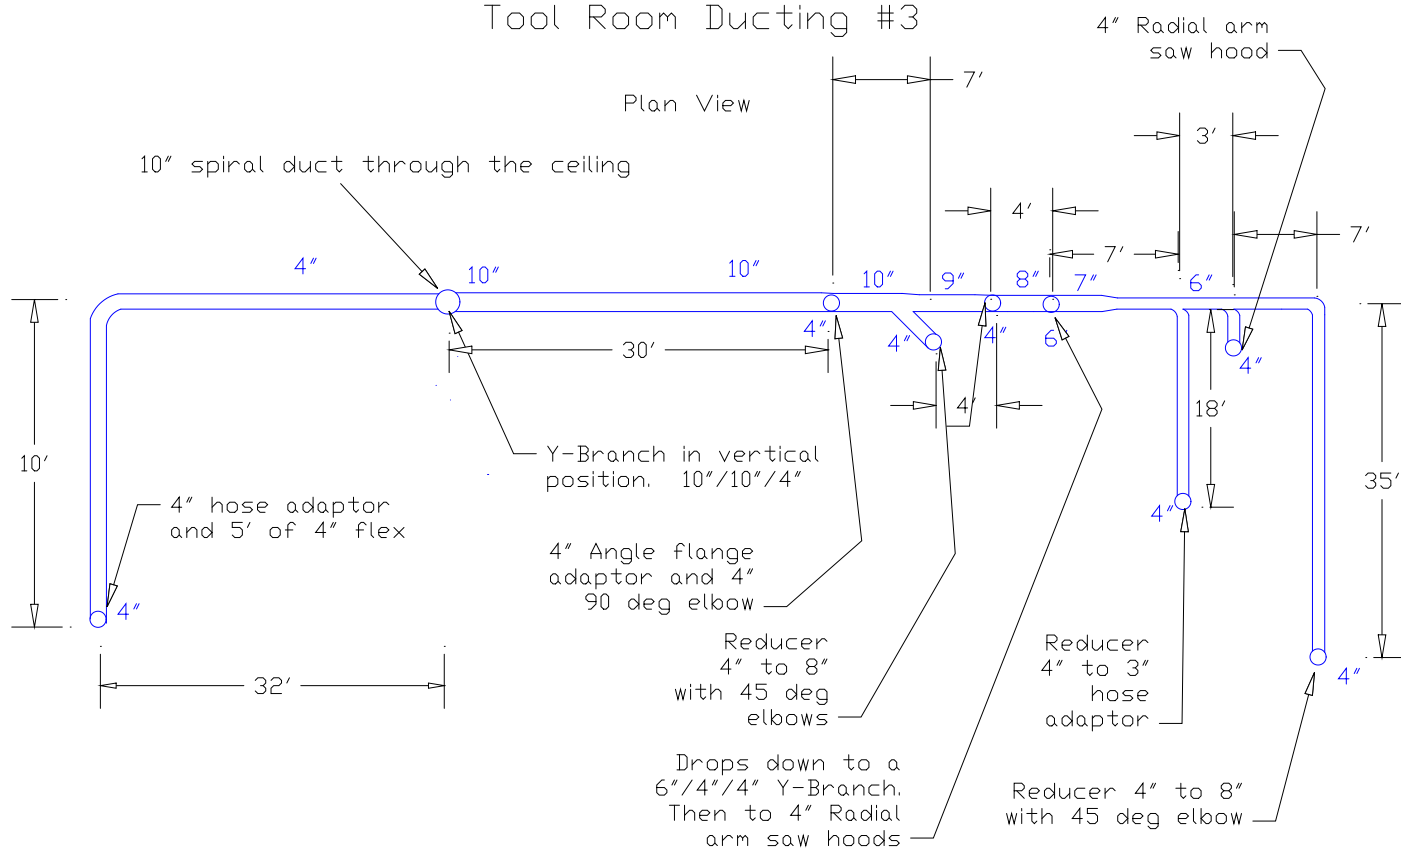

Notes:

- 1) Each drop has a blast gate to allow for air flow adjustments.
- 2) Ceiling Height 11'
- 3) Each Drop: 435 CFM
4" Diameter
Duct velocity is 4900 FPM

Industrial Air Quality		IAQ
102 AG DRIVE Youngsville, NC 27596		
P# 919-562-7181 F# 919-562-7182		
Project: Alcoa-Waco, TX		
Drawing: Tool Room Duct 3		
Date: 8/25/08		Drawn by: RAV
Revision Date:		