


Vacuum Piping layout Plan View

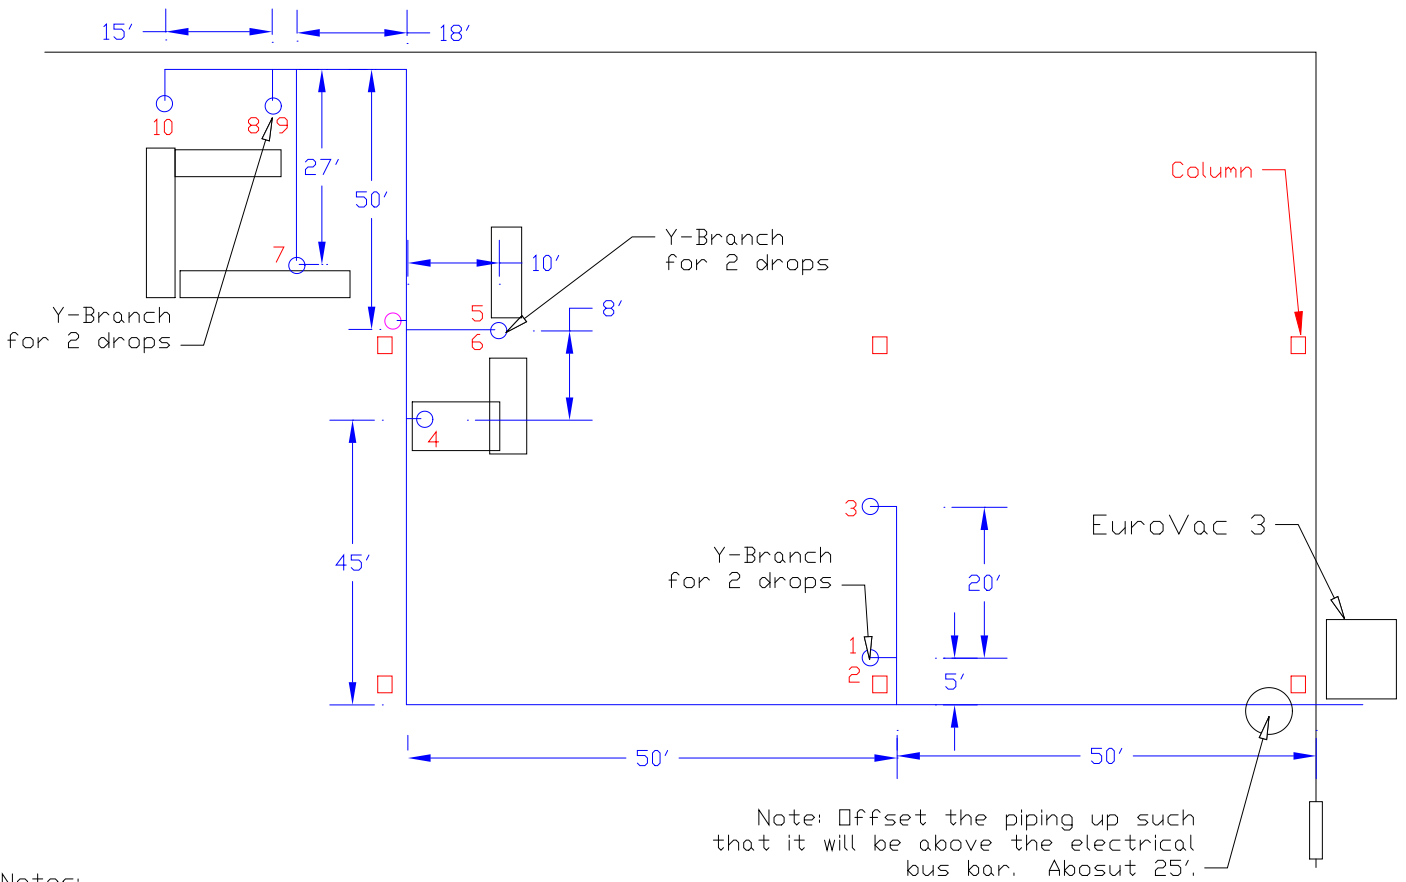

Notes:

- A) Eurovac 3 control panel to accept 208 volts 3phase
- B) From the Eurovac unit run up the wall about 20' through an existing opening. Flasing of hole by others.
- C) There are 10 drops for tools and 1 drop for cleaning. note the cleaning tools can fit any of the drops.

Industrial Air Quality		IAQ
102 AG DRIVE Youngsville, NC 27596		
P# 919-562-7181 F# 919-562-7182		
Project: American Steel		
Drawing: Piping layout		
Date: 1/31/08	Drawn by: RAV	
Sheet No:		