


# Ductwork Layout for Oskar Unit Plan View

Grinder 4

Grinder 5

Grinder 3

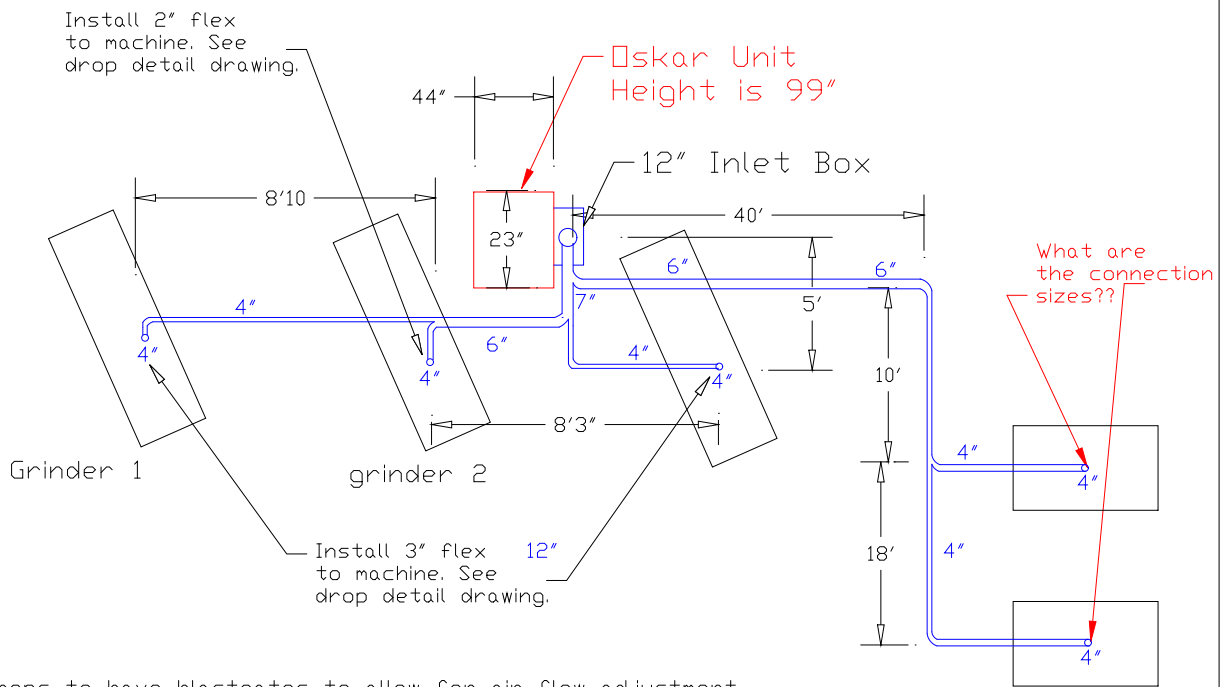

**Notes:**

1. All drops to have blastgates to allow for air flow adjustment
2. Ceiling height is 19'
3. Install 12" bleed valve in vertical position of 12" duct.
4. Electrical requirements.  
Motor is 2Hp 460 volts 3Phase 60 Hertz TEFC  
Full load amps are 4.0

Industrial Air Quality 102 AG DRIVE Youngsville, NC 27596 PH 919-562-7181 F# 919-562-7182	<b>IAQ</b>
Project: Becton Dickson	
Drawing: Oskar Duct layout	
Date: 11/30/07 Drawn by: RAV	
Revision Date: 12/19/07 DDJ	