




Boilermakers Local 242 Duct Layout

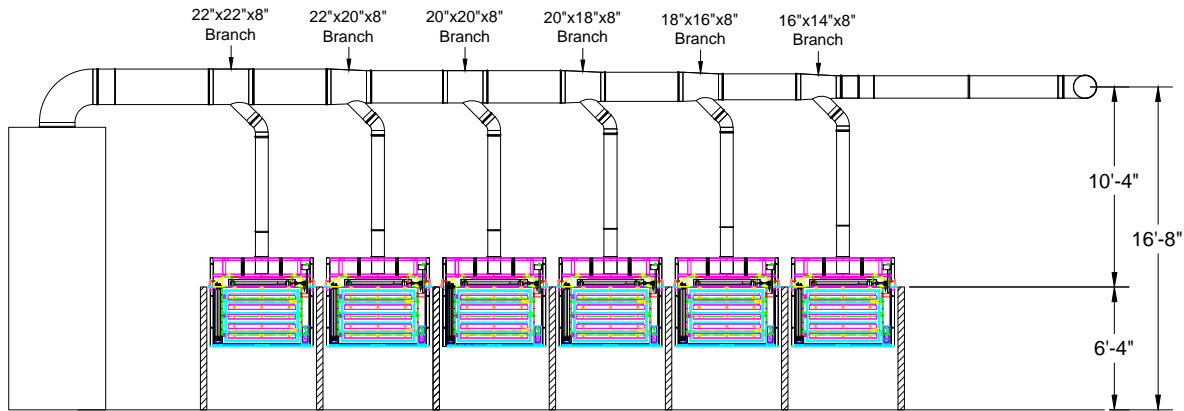

Elevation View

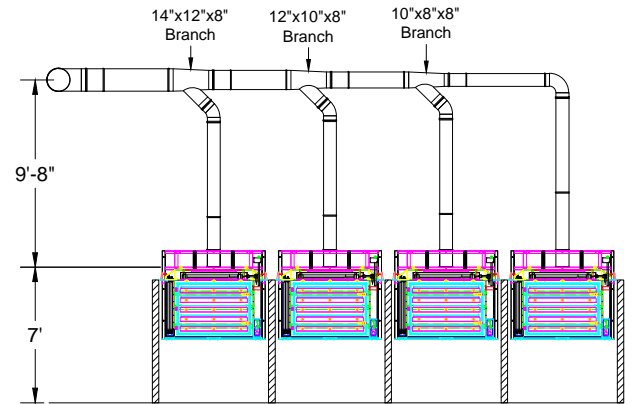

Elevation View

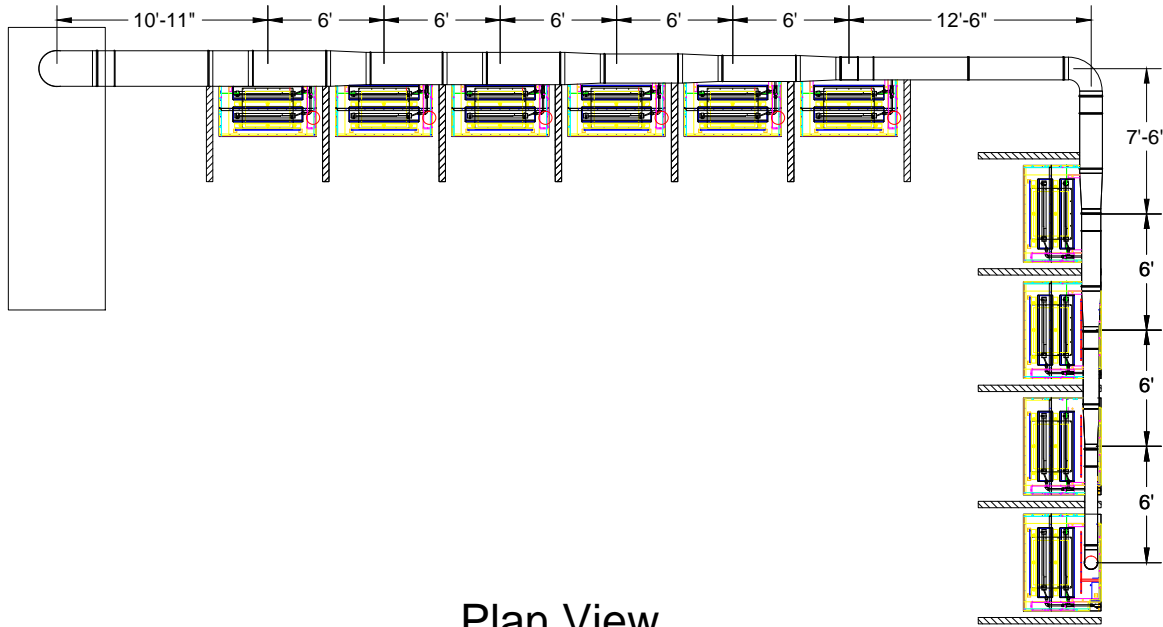

Plan View

Boilermakers - Portland

Notes:

1. 1200 CFM per drop
2. Transporting welding smoke
3. Avani will provide duct transition to collector