


Cummins Diesel - Duct Layout - Plan View

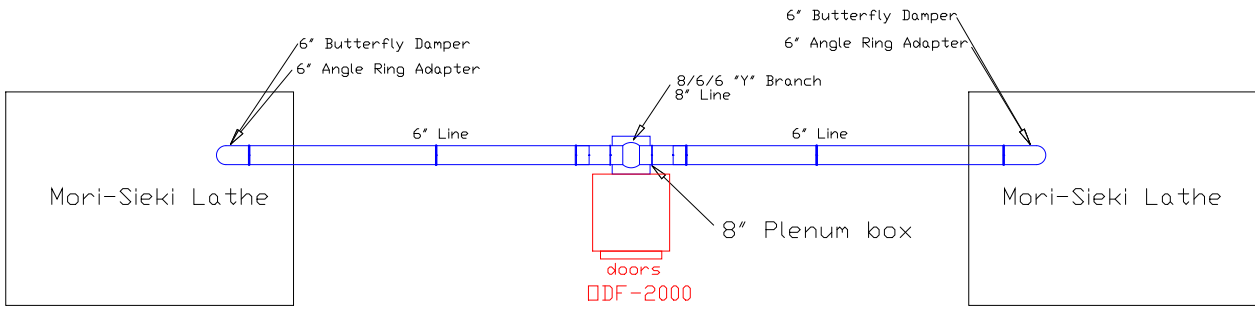

- Notes:
- A) Each drop will have a Butterfly damper for airflow adjustment.
 - B) DDF 2000 has a 3.5HP 460volt 3Phase motors. Full load amps are 4.6amps.
 - C) Drain line: P-Trap made of 3/4" PVC with union end ball valve.
 - D) Duct run is 12' from floor to bottem of duct.

Industrial Air Quality IAQ	
95 Cypress Drive Youngsville, NC 27596	
P# 919-562-7181 F# 919-562-7182	
Project: Cummins Diesel	
Drawing: Plan View	
Date: 6/7/08	Drawn by: WWB
Sheet No: 2 of 2	Rev.: 0