


Equipment Layout for Honda on the platform

Plan View

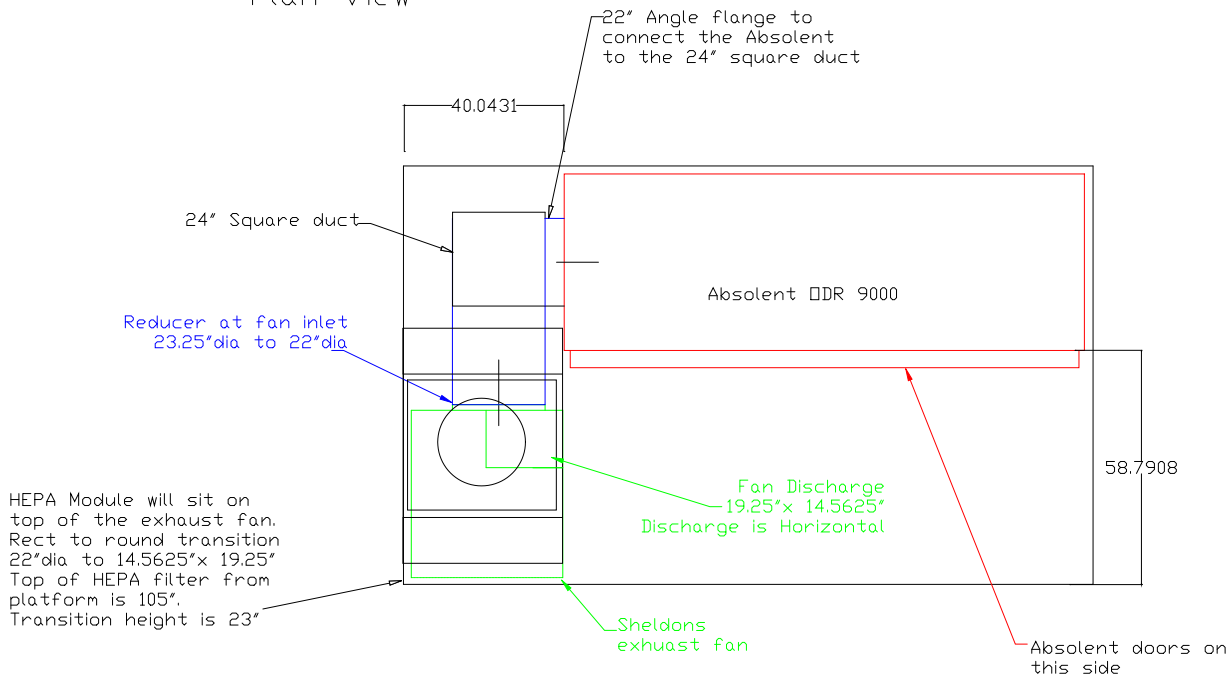

Notes:

1. Absolent DDR 9000 dims: 130.5" x 44.3" x 105.5" High
2. Sheldon's Exhaust fan dims: 42" x 38" x 34" High
3. HEPA Module dims: 59" x 39.4" x 47.6"
4. Exhaust Fan: 7500CFM at 14" S.P. 575volts 25HP

Industrial Air Quality		IAQ
102 AG DRIVE Youngsville, NC 27596		
P# 919-562-7181 F# 919-562-7182		
Project: Honda / Canada		
Drawing: Equipment layout		
Date: 7/15/07		Drawn by: RAV
Sheet No:		