


Plan View of Ductwork Layout
 Block Line - #2 - CNC Cell#2

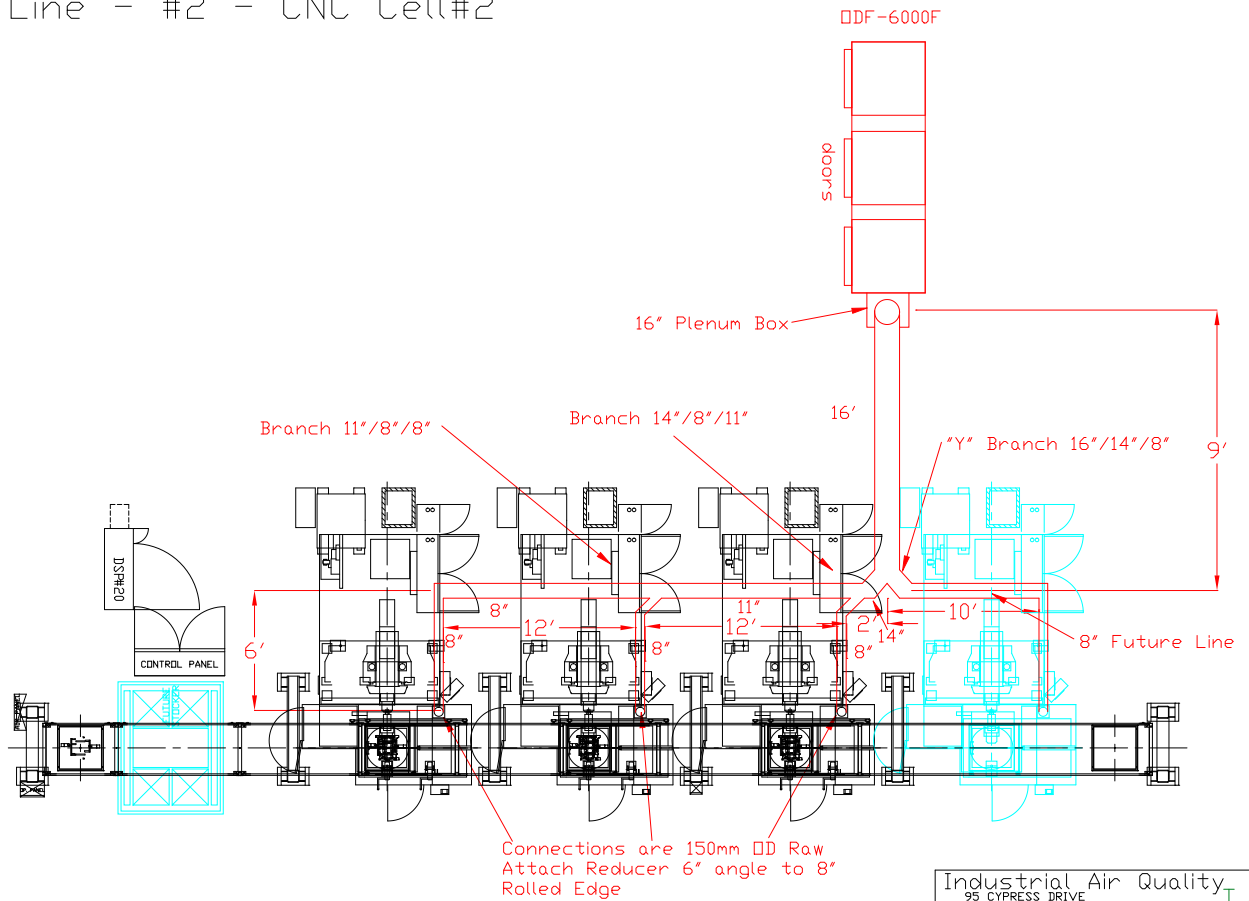

Notes:

- A) Each drop will have a Butterfly damper for airflow adjustment.
- B) Each drop will have a Bleed in valve to allow for balancing.
- C) DDF 6000F has 3 - 3.5HP 460volt 3Phase motors. Full load amps are 4.6amps each.
- D) Drain line: P-Trap made of 3/4" Galvanized with ball valve and unions. IAQ to provide. Honda to provide piping to sump.

Industrial Air Quality	
95 CYPRESS DRIVE	
Youngsville, NC 27596	
P# 919-562-7181	F# 919-562-7182
Project: Honda Canada	
Drawing: Block #2 CNC Cell #2	
Date: 03/27/08	Drawn by: W/WB
Sheet No:	