


Plan View of Ductwork Layout
Block Line-#3-CNC Cell # 3

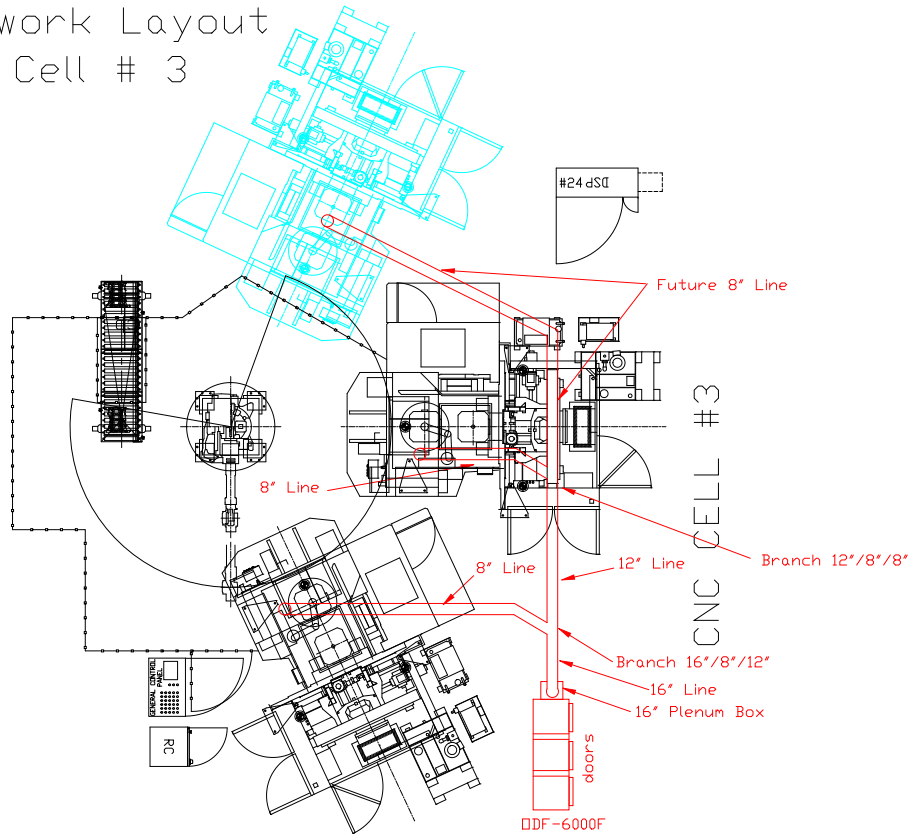

Notes:

- A) Each drop will have a Butterfly damper for airflow adjustment.
- B) Each drop will have a Bleed in valve to allow for balancing.
- C) DDF 6000F has 3 - 3.5HP 460volt 3Phase motors. Full load amps are 4.6amps each.
- D) Drain line: P-Trap made of 3/4" Galvanized with ball valve and unions. IAQ to provide. Honda to provide piping to sump.

Industrial Air Quality 95 CYPRESS DRIVE Youngsville, NC 27596 P# 919-562-7181 F# 919-562-7182	IAQ
Project: Honda Canada	
Drawing: Block #3 CNC Cell #3	
Date:03/25/08 Drawn by: WWB	
Sheet No:	