


Plan View of Ductwork Layout  
Head #8 MTS Collector

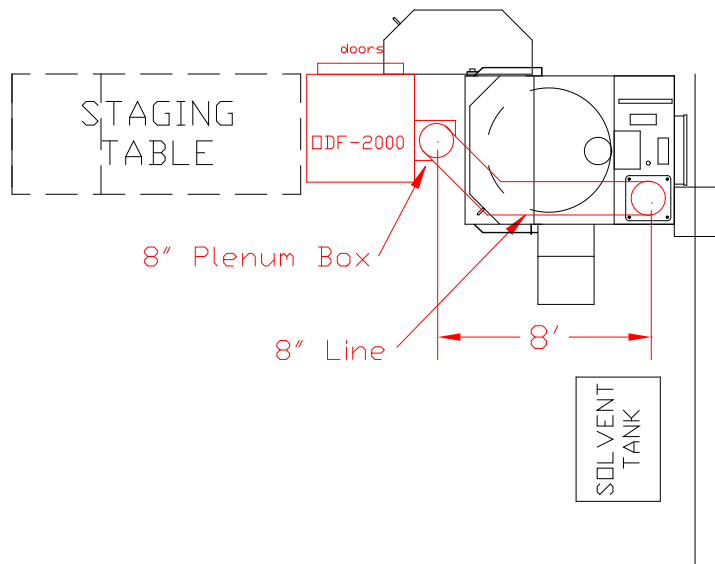

Notes:

- A) Drop will have a Butterfly damper for airflow adjustment.
- B) Drop will have a Bleed in valve to allow for balancing.
- C) DDF-2000 has 3.5HP 460volt 3Phase motor. Full load amps are 4.6amps.
- D) Drain line: P-Trap made of  $\frac{3}{4}$ " Galvanized with ball valve and unions. IAQ to provide. Honda to provide piping to sump.

Industrial Air Quality		<b>IAQ</b>
95 Cypress Drive Youngsville, NC 27596		
P# 919-562-7181 F# 919-562-7182		
Project: Honda canada		
Drawing: Head#8 MTS Collector		
Date: 03/29/08		Drawn by: WWB
Sheet No:		