


Johnson Controls - Battle Creek Basic Cell Layout

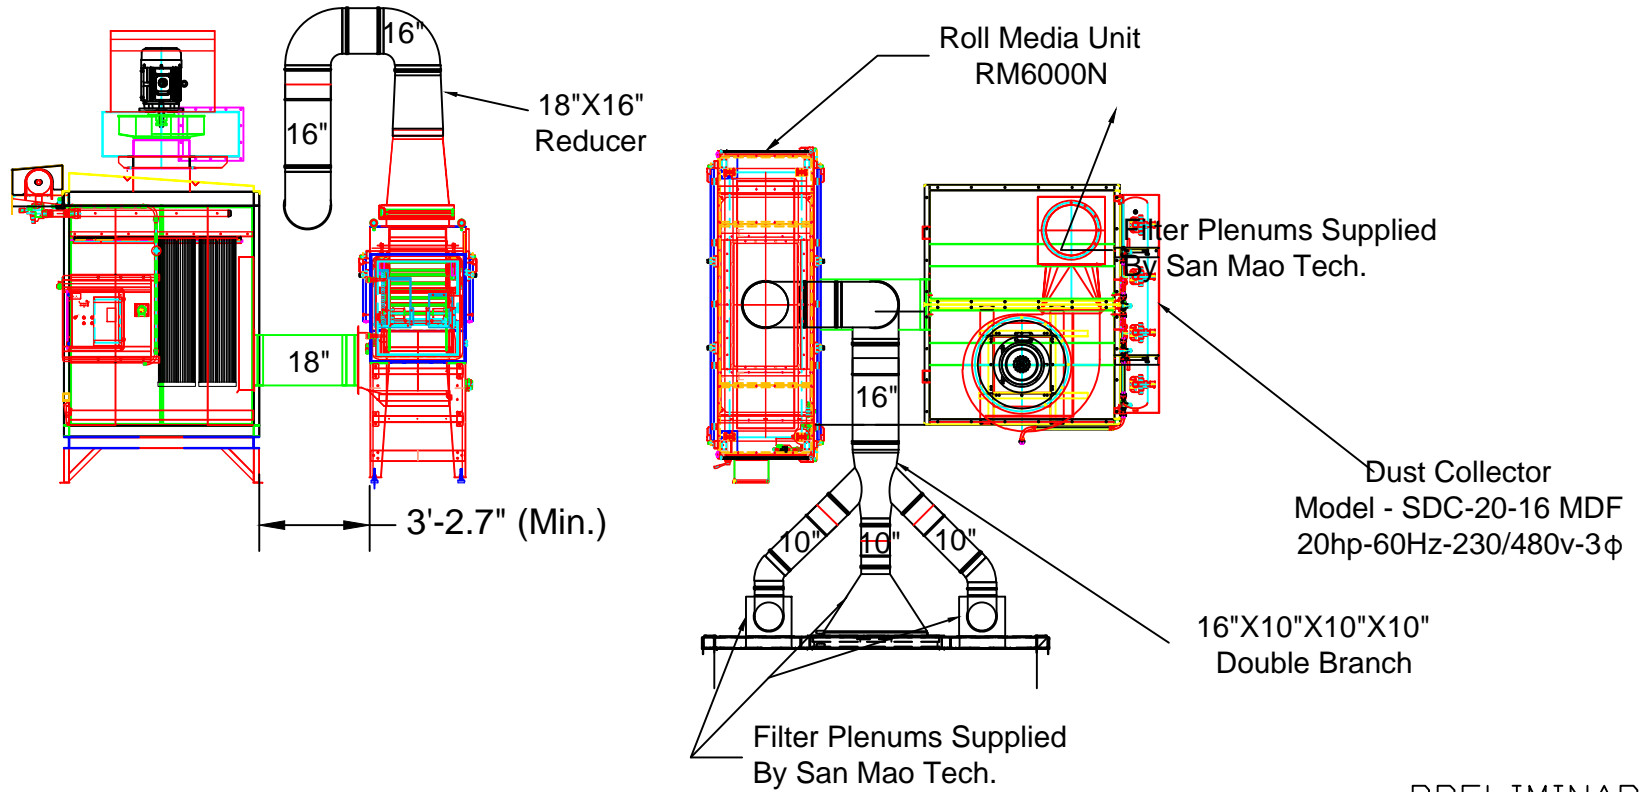

PRELIMINARY

Notes:

- 1) Clamp together duct
- 2) Standard installation duct free standing
- 3) Butterfly valve on each drop
- 4) SDC-20-16MDF Collector
- 5) Fan/Silencer/VFD

Any Customer requested, or caused changes or deviations from the approved drawing that effect T&M will require a change order.	This product has not been tested for seismic calculations.
--	--

Avani Environmental Intl. Inc.
95 Cypress Drive
Youngsville, NC 27596
P# 919-570-2862 F# 919-570-2863

Avani

Project: Johnson Controls - Battle Creek	
Drawing: Basic Duct Layout	
Date: 10/27/2015	Drawn by: WWB
Sheet No: 1 of 1	Rev: 1