



Johnson Controls AS Found Air Flow Reading At Pick-Up Points Inside Enclosure


Section
#1

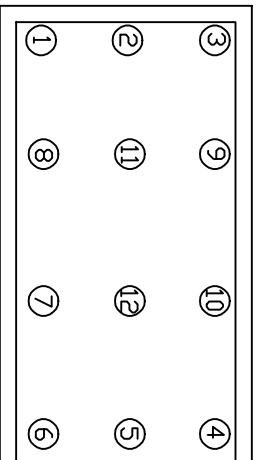

Section
#2

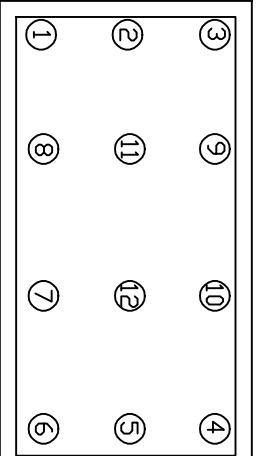

Section
#3

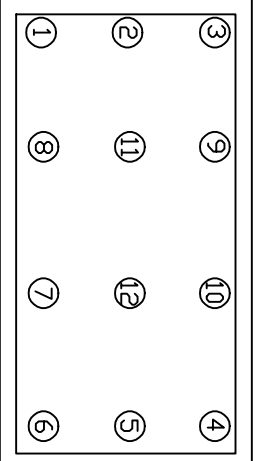

Location #	Filter Section #1	V	CFM
Test Point	VP		
1	1072	2764	
2	820	2114	
3	750	1934	
4	580	1495	
5	659	1599	
6	643	1558	
7	1006	2594	
8	1250	3223	
9	937	2416	
10	890	2295	
11	945	2436	
12	827	2132	
13		0	
14		0	
15		0	
Average	0.00	0	2229.88
Duct Area:	2.58		

Length	Width	Area SF
27.50	13.50	2.58
	Diameter	0.00

Location #	Filter Section #2	V	CFM
Test Point	VP		
1	789	2034	
2	833	2148	
3	817	2106	
4	382	995	
5	386	995	
6	437	1127	
7	551	1421	
8	782	2016	
9	752	1939	
10	571	1472	
11	756	1949	
12	514	1325	
13		0	
14		0	
15		0	
Average	0.00	0	1626.37
Duct Area:	2.58		

Length	Width	Area SF
27.50	13.50	2.58
	Diameter	0.00

Location #	Filter Section #3	V	CFM
Test Point	VP		
1	366	944	
2	335	864	
3	222	572	
4	199	513	
5	236	608	
6	256	660	
7	346	892	
8	342	882	
9	256	660	
10	240	619	
11	308	794	
12	226	583	
13		0	
14		0	
15		0	
Average	0.00	0	718.01
Duct Area:	2.58		

Length	Width	Area SF
27.50	13.50	2.58
	Diameter	0.00

Avani Environmental Intl.
95 Cypress Drive
Youngsville, NC 27596
PH 919-570-2862 F# 919-570-2863

Avani

Project: Johnson Controls
Drawing: AS Found Readings
Date: 2/15/11 Drawn by: WWB
Sheet No: 2 of 5 Rev: 0