


# Johnson Controls Robotic Welding Cell #3 - July 2012

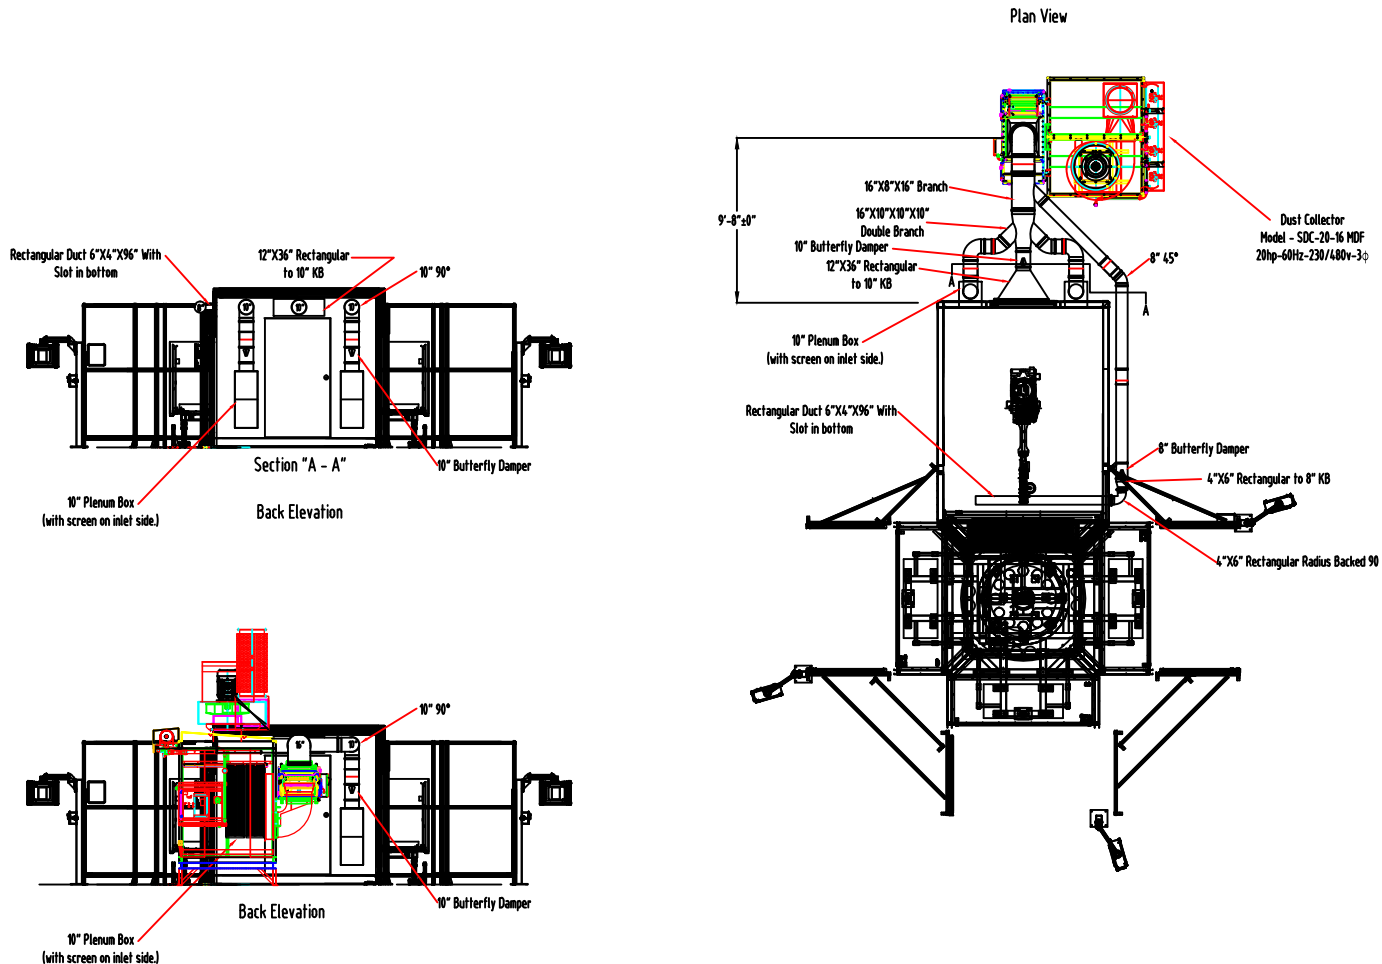

**Notes:**

- 1) Inlet to the RM-6000 on the collector must be in line with the center of the enclosure.
- 2) Center of the RM-6000 inlet must be at least 9'-8" from the enclosures.
- 3) The top inlet plate on the RM-6000 will need to be replaced with one that will allow the 16" elbow to connect to the plate without the use of a reducer. (Avani to supply)

Avani Environmental Intl.  
95 Cypress Drive  
Youngsville, NC 27596  
P# 919-570-2862 F# 919-570-2863

**Avani**

Project: Johnson Controls	
Drawing: Robotic Welding Cell #3	
Date: 7/29/12	Drawn by: WWB
Sheet No: 1 of 1	Rev.: 1