


THE INFORMATION ON THIS MANUAL IS BASED ON THE CURRENTLY AVAILABLE INFORMATION FROM THE MANUFACTURERS OF THE EQUIPMENT TO WHICH THIS MANUAL APPLIES. THE INFORMATION IS SUBJECT TO CHANGE WITHOUT NOTICE. THE INFORMATION IS NOT TO BE USED FOR ANY OTHER PURPOSES WITHOUT THE WRITTEN PERMISSION OF THE MANUFACTURER.

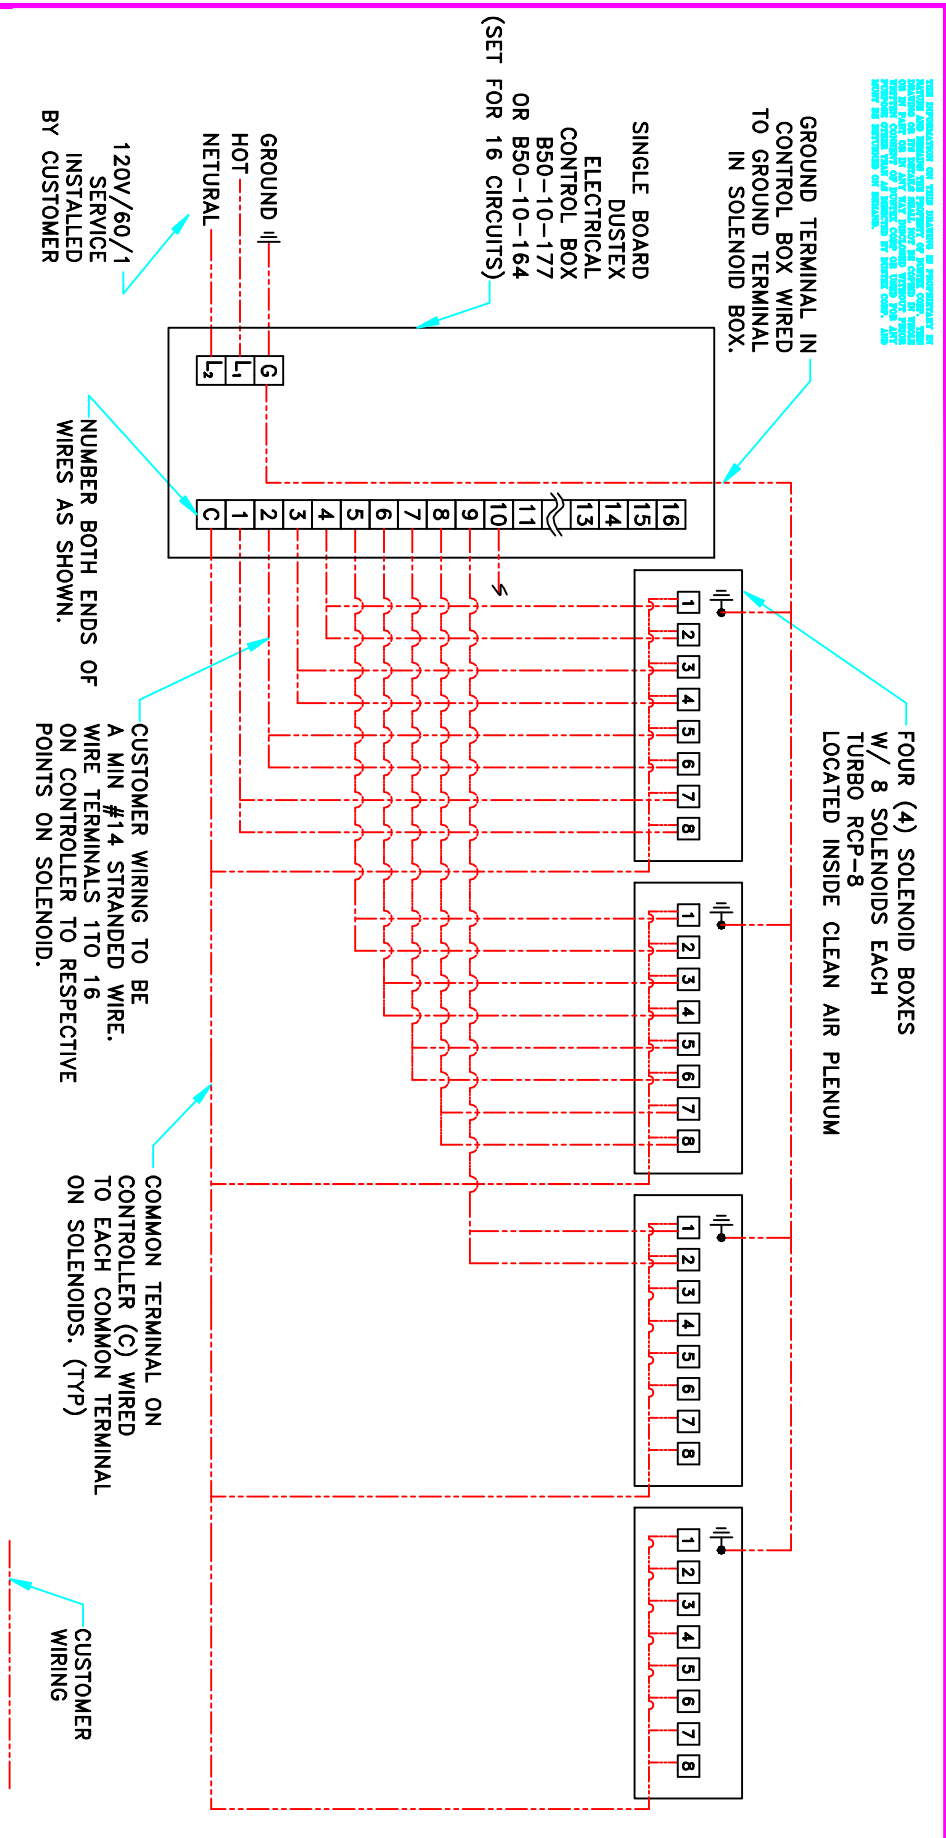

CONTROLLER MUST BE WIRED TO OPERATE INDEPENDENTLY OF SYSTEM FAN. A DELAY TIMER WHICH TURNS OFF CONTROLLER 5 TO 60 MINUTES AFTER FAN SHUT DOWN IS RECOMMENDED.

REV.	DESCRIPTION	DATE	BY	CHKD.	DATE
1	WIRING SCHEMATIC	11/08	TJW		
2	FOR TURBO VALVES	1/97	TJW		
3	MISC	10/98	WH		
4	ADDED NOTES	3/25/93	WH		

SEC. NO.	ISS. PER.	AVAIL. PER.	DESCRIPTION	ENG. PART NO.	MAT'L.	SERIFICATIONS	COMP./REVISED

DATE	SIZE	DRAWING NUMBER	REV.
		B50-50-143	c

