


# Ductwok Layout for Matsura

Plan View

Notes:

A) ODF 2000 has 3.5HP motor.  
At 460Volt full load amps

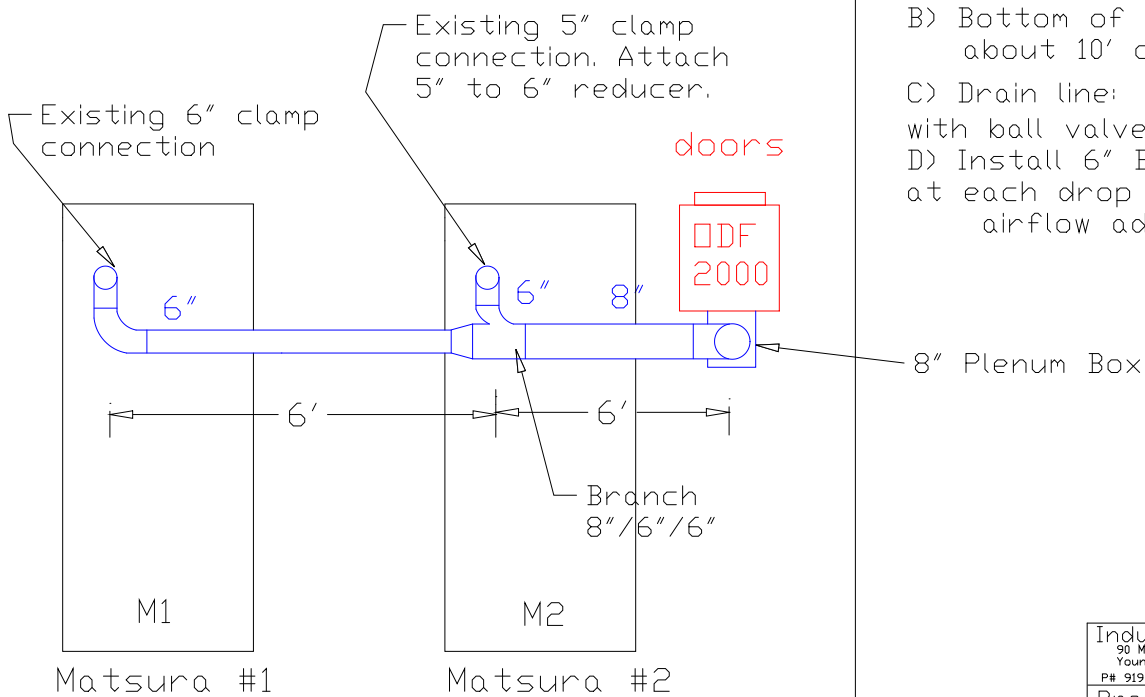

are 5.5.  
B) Bottom of ductwork about about 10' off of floor.  
C) Drain line:  $\frac{3}{4}$ " PVC P-Trap with ball valve.  
D) Install 6" Butterfly Damper at each drop to allow for airflow adjustment.

Industrial Air Quality 90 Mosswood Blvd Suite 100 Youngsville, NC 27596 P# 919-562-7181 F# 919-562-7182	<b>IAQ</b>
Project: Matsura	
Drawing: Ductwork layout	
Date: 11/12/08 Drawn by: RAV	
Sheet No:	