


Medtronic Building #2 System B

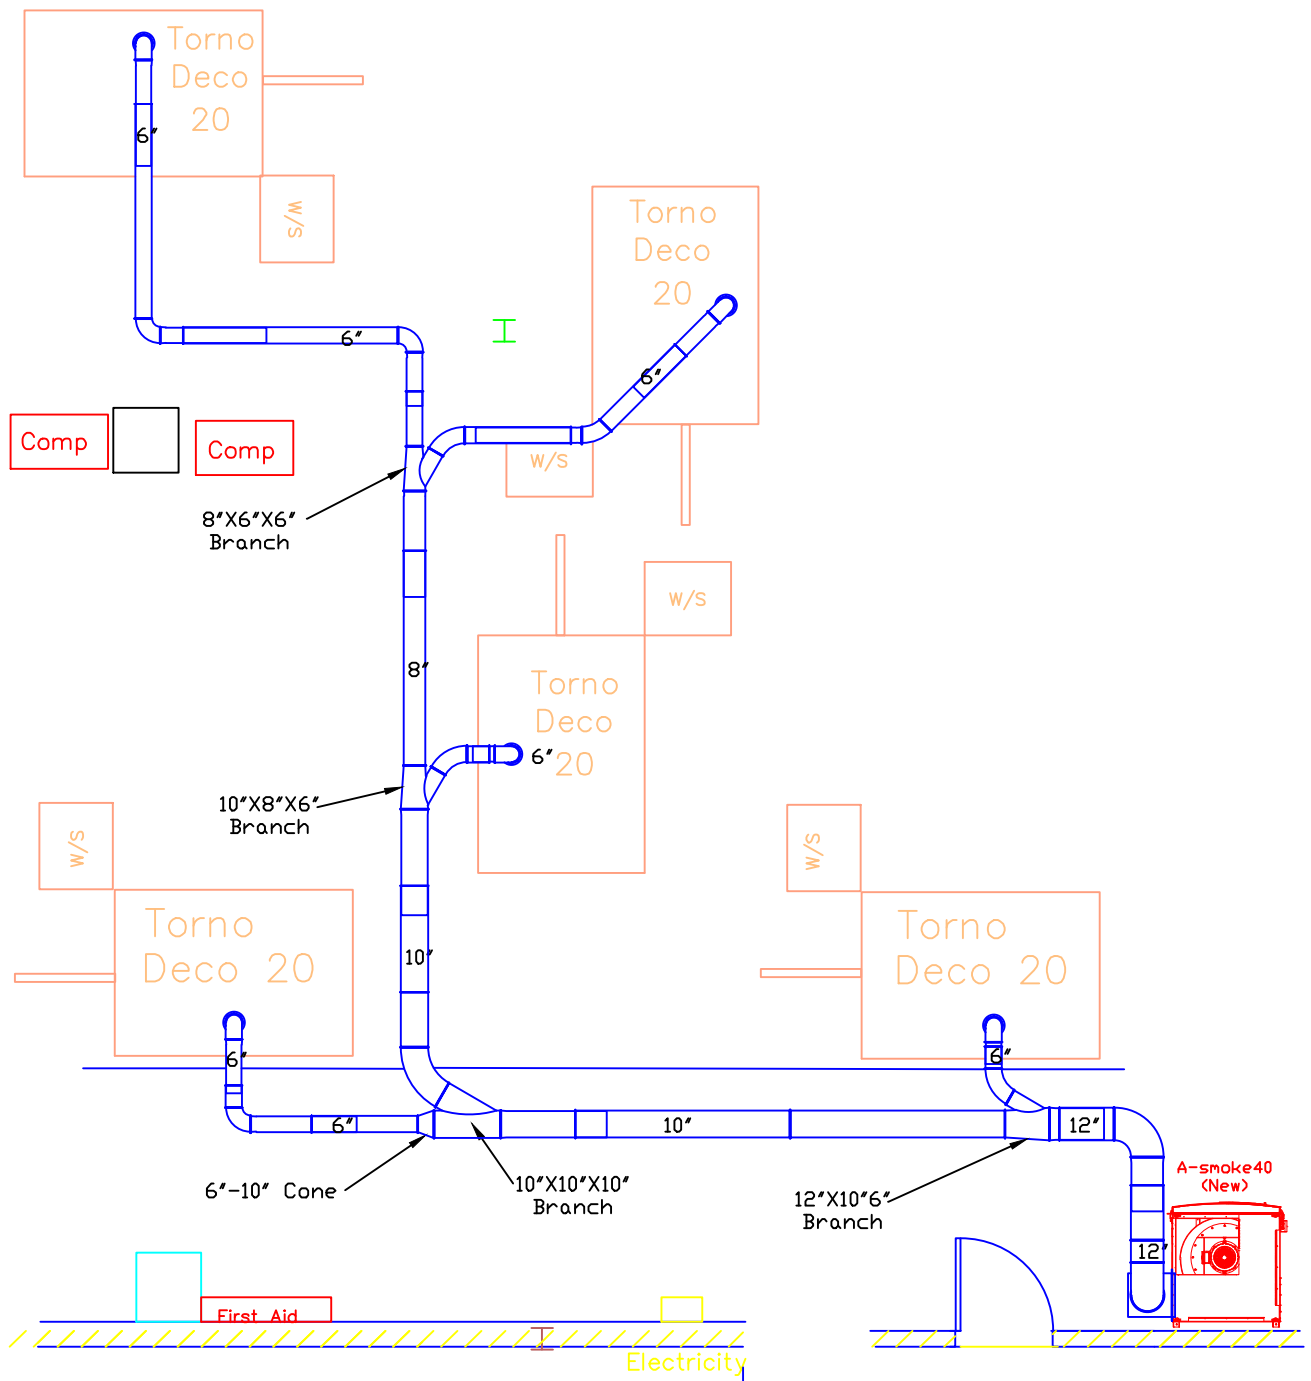


Notes:

- 1) A*smoke40 Standard Unit
- 2) All 5 drops have throttle valves
- 3) All 5 drops have fire dampers
- 4) All drops are 6"

PRELIMINARY

This product has not been tested for seismic calculations. Any Customer requested, or caused changes or deviations from the approved drawing that effect T&M will require a change order.

Avani Environmental 95 Cypress Drive Youngsville, NC 27596 P# 919-570-2862 F# 919-570-2863	
Project: Medtronic Bldg. 2	
Drawing: System B	
Date: 6/15/15 Drawn by: WWB	
Sheet No: 1	Rev.: 0