


Medtronic Building #2 System C

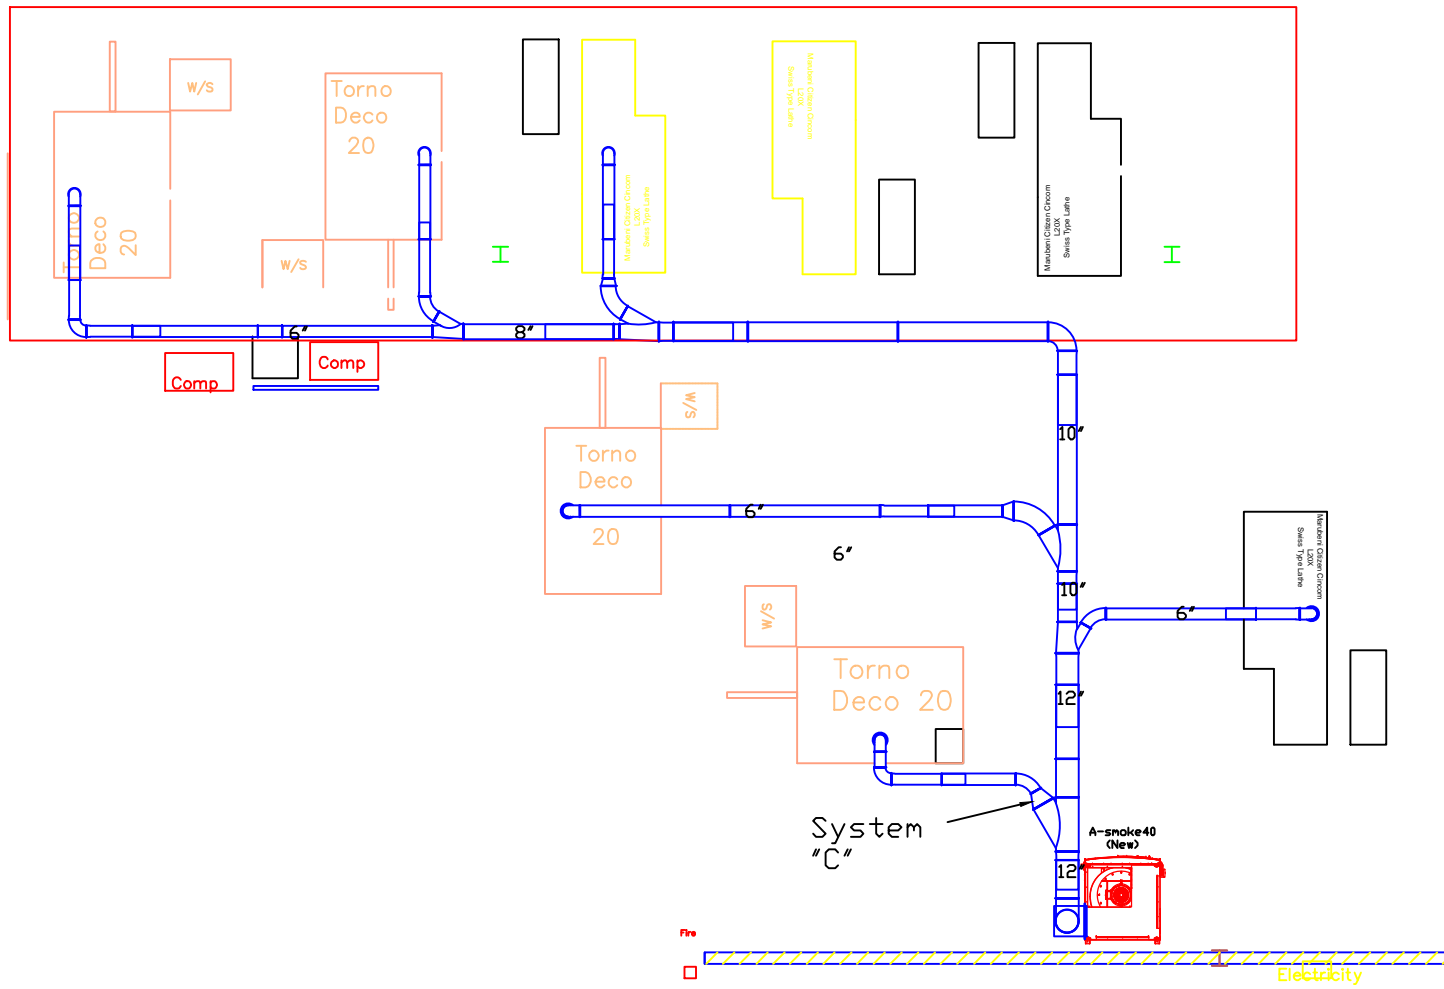

Notes:

- 1) A*smoke40 Standard Unit
- 2) All 6 drops have throttle valves
- 3) All 6 drops have fire dampers
- 4) All drops are 6"

PRELIMINARY

This product has not been tested for seismic calculations.

Any Customer requested, or caused changes or deviations from the approved drawing that effect TEM will require a change order.

Avani Environmental Intl. Inc. 95 Cypress Drive Youngsville, NC 27596 P# 919-570-2862 F# 919-570-2863		Avani
Project: Medtronic Bldg. 2		
Drawing: System C		
Date: 6/15/15	Drawn by: WWB	
Sheet No: 1	Rev 0	