


# Duct Layout for the Davenports

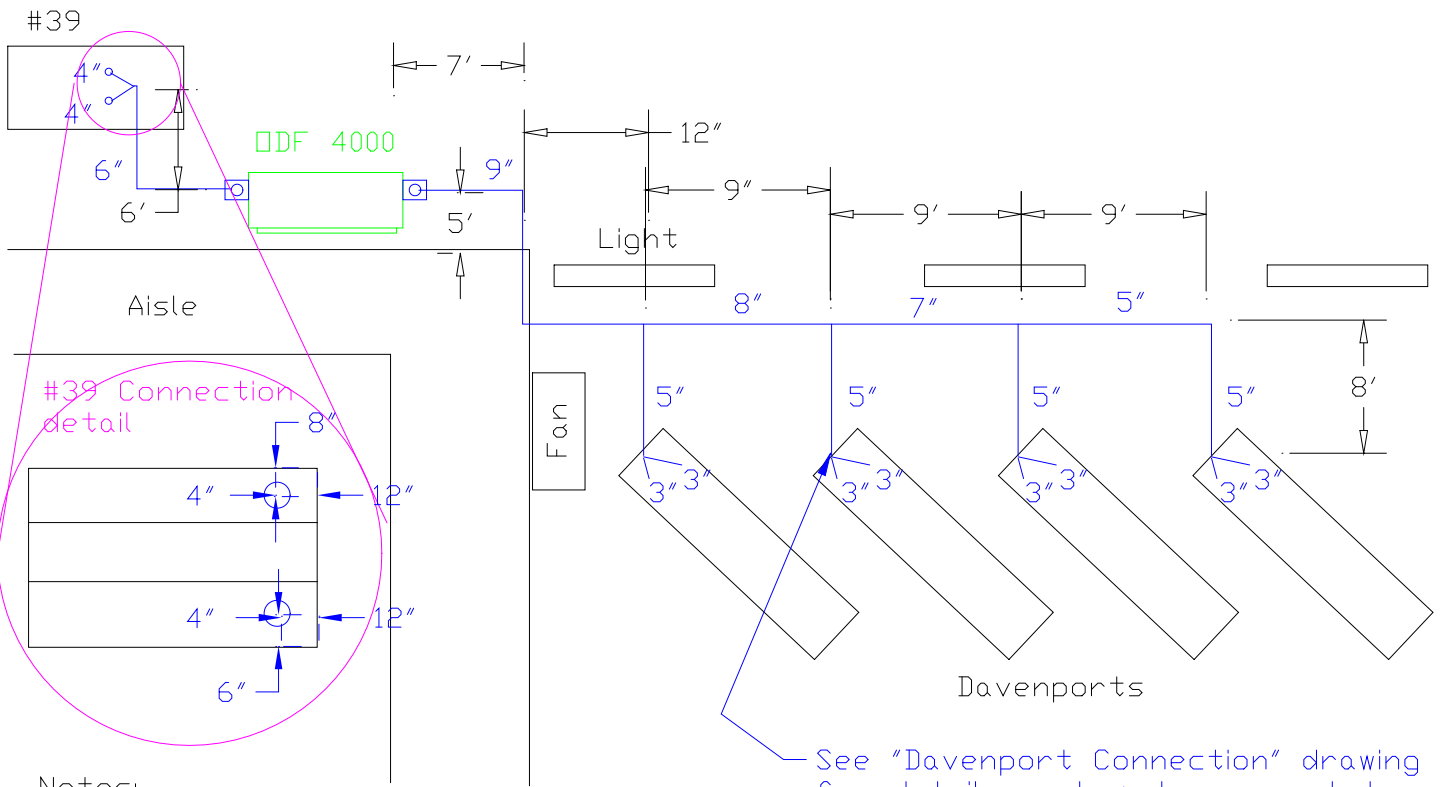

**Notes:**

- A) DDF 4000 is to sit on floor
- B) Drain line: 3/4" PVC "P" Trap into bucket
- C) Hang bottom of duct at 12'2" and run duct between light and fan (over the black iron pipe).

See "Davenport Connection" drawing for details on how to connect to the Davenport. All 4 are identical.

Industrial Air Quality		<b>IAQ</b>
102 AG DRIVE Youngsville, NC 27596		
P# 919-562-7181	F# 919-562-7182	
Project: YaleCommerical		
Drawing: Duct Davenport		
Date: 7/1/03	Drawn by: RAV	
Sheet No:		