




Ken Haga  
Avani Environmental Intl., Inc.

**Evageline Louisiana Technical College**

Qty 60 Welding Booths  
Collectors shall require 20,000CFM, 14,000CFM, 12,000CFM, and 14,000CFM  
(Preliminary - or exhaust fans)

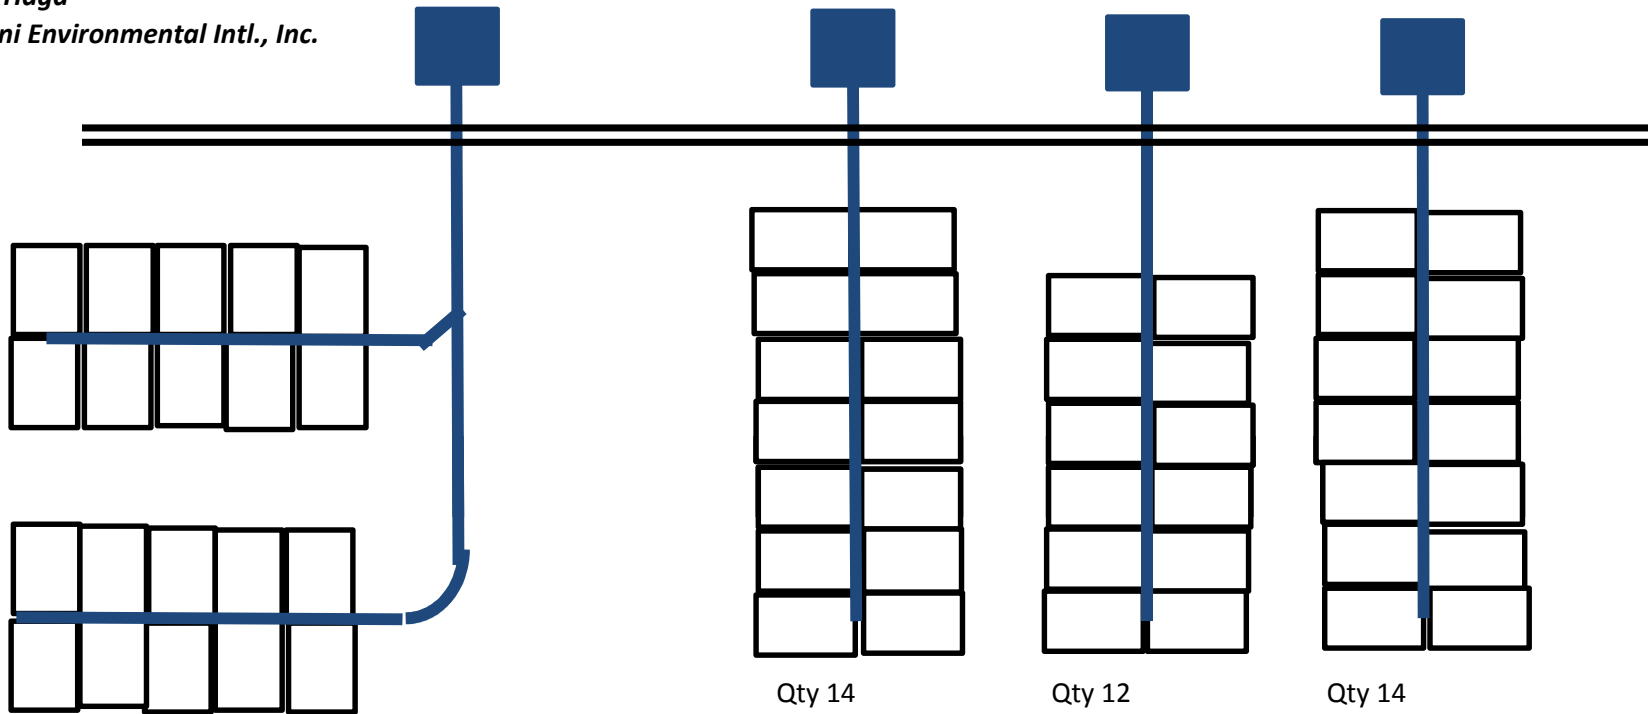

Grouping of (20) 4x4 WB-1000 or WB-5000 (preferred)

Booth Dimensions: 4'W x 4'D (inside dimensions) with standard 8'H  
Welding Curtains  
WB-1000 as primary and optional WB-5000

Note: That pricing on the booths first is primary and collector/fan/ductwork & labor to be determined.

Notes:  
Building 14'H @ eaves  
20'H Ceiling  
Hoist height is 14'H